



# INSTRUCTION & SAFETY MANUAL

## SIL 2 Temperature Signal Converter, And Trip Amplifiers Din-Rail Model D1073S

## Characteristics

**General Description:** The single channel DIN Rail Temperature Signal Converter and Trip Amplifier D1073S accepts a low level dc signal from millivolt, thermocouple or RTD temperature sensor, located in Hazardous Area, and converts, with isolation, the signal to drive a Safe Area load. Output signal can be direct or reverse. Two independent Alarm Trip Amplifiers are also provided. Each alarm energizes, or de-energizes, an SPST relay for high, low, low-startup or burnout alarm functions. The two alarm relays trip points are settable over the entire input signal range.

**Function:** 1 channel I.S. input from mV, thermocouples, 3-4 wires resistance thermometers, transmitting potentiometers, provides 3 port isolation (input/output/supply) and current (source mode) or voltage output signal. The programmable RTD line resistance compensation allows the use of 2 wires RTDs or error compensation for 3-4 wires RTDs. Reference junction compensation can be automatic, with option 91, or fixed by software setting. In addition it provides two SPST relay alarm contacts with adjustable alarm trip point.

**Signalling LEDs:** Power supply indication (green), burnout (red), alarm A (red), alarm B (red).

**Configurability:** Totally software configurable, no jumpers or switches, input sensor, connection mode, burnout operation, mA or V output signal, alarm trip point, high, low, low-startup or burnout alarm mode, NE/ND relay operation, hysteresis, delay time, by GM Pocket Portable Configurator PPC1090, powered by the unit or configured by PC via RS-232 serial line with PPC1092 Adapter and SWC1090 Configurator software. A 16 characters tag can be inserted using SWC1090 Configurator software.

**EMC:** Fully compliant with CE marking applicable requirements.

## Technical Data

**Supply:** 24 Vdc nom (20 to 30 Vdc) reverse polarity protected, ripple within voltage limits  $\leq 5$  Vpp.

**Current consumption @ 24 V:** 65 mA with 20 mA output and relays energized typical.

**Power dissipation:** 1.5 W with 24 V supply, 20 mA output and relays energized typical.

**Max. power consumption:** at 30 V supply voltage, overload condition, relays energized and PPC1090 connected, 2.1 W.

**Isolation (Test Voltage):** I.S. In/Outs 1.5 KV; I.S. In/Supply 1.5 KV; Analog Out/Supply 500 V; Analog Out/Alarm Outs 1.5 KV; Alarm Outs/Supply 1.5 KV; Alarm Out/Alarm Out 1.5 KV.

**Input:** millivolt or thermocouple type A1, A2, A3, B, E, J, K, L, Lr, N, R, S, S1, T, U or 3-4 wires RTD Pt100, Pt200, Pt300 to DIN43760, Pt100 (0.3916), Ni100, Ni120 or Pt500, Pt100, Pt50, Cu100, Cu53, Cu50, Cu46 (russian standard) or 3 wires transmitting potentiometer (50  $\Omega$  to 20 K $\Omega$ ).

**Integration time:** 500 ms.

**Resolution:** 5  $\mu$ V on mV or thermocouple, 1  $\mu$ V thermocouple type B, R, S, S1, 2  $\mu$ V thermocouple A1, A2, A3, 20 m $\Omega$  on RTD, 0.05 % on transmitting potentiometer.

**Visualization:** 0.1  $^{\circ}$ C on temperature, 10  $\mu$ V on mV, 0.1 % on potentiometer.

**Input range:** within rated limits of sensor (-10 to + 80 mV).

**Measuring RTD current:**  $\leq 0.5$  mA.

**RTD line resistance compensation:**  $\leq 10$   $\Omega$ .

**RTD line resistance error compensation:** - 5 to + 20  $\Omega$ , programmable.

**Thermocouple Reference Junction Compensation:** automatic, by external sensor OPT1091 separately ordered, or fixed programmable from - 60 to + 100  $^{\circ}$ C.

**Thermocouple burnout current:**  $\leq 30$  nA.

**Burnout:** enabled or disabled. Analog output can be programmed to detect burnout condition with downscale or highscale forcing. Burnout condition signalled by red front panel LED.

Alarms can be programmed to detect burnout condition.

**Output:** 0/4 to 20 mA, on max. 600  $\Omega$  load source mode, current limited at 22 mA or 0/1 to 5 V or 0/2 to 10 V signal, limited at 11 V.

**Resolution:** 2  $\mu$ A current output or 1 mV voltage output.

**Transfer characteristic:** linear or reverse on mV or transmitting potentiometer, temperature linear or reverse on temperature sensors.

**Response time:**  $\leq 50$  ms (10 to 90 % step change).

**Output ripple:**  $\leq 20$  mVrms on 250  $\Omega$  load.

**Alarm:**

**Trip point range:** within rated limits of input sensor (see input for step resolution).

**ON-OFF delay time:** 0 to 1000 s, 100 ms step, separate setting.

**Hysteresis:** 0 to 5  $^{\circ}$ C for temperature sensor input, 0 to 50 mV for mV input, 0 to 50 % for potentiometer input (see input for step resolution).

**Output:** voltage free SPST relay contact.

**Contact rating:** 2 A 250 Vac 500 VA, 2 A 250 Vdc 80 W (resistive load).

**Performance:** Ref. Conditions 24 V supply, 250  $\Omega$  load, 23  $\pm 1$   $^{\circ}$ C ambient temperature.

**Input:**

**Calibration and linearity accuracy:**  $\leq \pm 40$   $\mu$ V on mV or thermocouple, 200 m $\Omega$  on RTD, 0.2 % on potentiometer or  $\pm 0.05$  % of input value.

**Temperature influence:**  $\leq \pm 2$   $\mu$ V, 20 m $\Omega$ , 0.02 % or  $\pm 0.01$  % of input value for a 1  $^{\circ}$ C change.

**Ref. Junction Compensation influence:**  $\leq \pm 1$   $^{\circ}$ C (thermocouple sensor).

**Analog Output:**

**Calibration accuracy:**  $\leq \pm 0.1$  % of full scale.

**Linearity error:**  $\leq \pm 0.05$  % of full scale.

**Supply voltage influence:**  $\leq \pm 0.05$  % of full scale for a min to max supply change.

**Load influence:**  $\leq \pm 0.05$  % of full scale for a 0 to 100 % load resistance change.

**Temperature influence:**  $\leq \pm 0.01$  % on zero and span for a 1  $^{\circ}$ C change.

**Compatibility:**

 CE mark compliant, conforms to Directive: 2014/34/EU ATEX, 2014/30/EU EMC, 2014/35/EU LVD, 2011/65/EU RoHS.

**Environmental conditions:**

**Operating:** temperature limits -20 to + 60  $^{\circ}$ C, relative humidity max 95 %.

**Storage:** temperature limits - 45 to + 80  $^{\circ}$ C.

**Safety Description:**



**ATEX:** II (1) G [Ex ia Ga] IIC, II (1) D [Ex ia Da] IIIC, I (M1) [Ex ia Ma] I, II 3G Ex nA IIC T4 Gc

**IECEX / INMETRO:** [Ex ia Ga] IIC, [Ex ia Da] IIIC, [Ex ia Ma] I, Ex nA IIC T4 Gc

associated electrical apparatus.

Uo/Voc = 10.8 V, Io/Isc = 9 mA, Po/Po = 24 mW at terminals 13-15-16.

Ui/Vmax = 18 V, Ci = 6 nF, Li = 0 nH at terminals 13-15-16.

Um = 250 Vrms, -20  $^{\circ}$ C  $\leq$  Ta  $\leq$  60  $^{\circ}$ C.

**Approvals:** DMT 01 ATEX E 042 X conforms to EN60079-0, EN60079-11, EN60079-26.

IECEX BVS 07.0027X conforms to IEC60079-0, IEC60079-11, IEC60079-26.

IMQ 09 ATEX 013 X conforms to EN60079-0, EN60079-15.

IECEX IMQ 13.0011X conforms to IEC60079-0, IEC60079-15.

UL & C-UL E222308 conforms to UL913, UL 60079-0, UL60079-11, UL60079-15, ANSI/ISA 12.12.01 for UL and

CSA-C22.2 No.157-92, CSA-E60079-0, CSA-E60079-11, CSA-C22.2 No. 213 and CSA-E60079-15 for C-UL.

FM & FM-C No. 3024643, 3029921C, conforms to Class 3600, 3610, 3611, 3810, ANSI/ISA 12.12.02, ANSI/ISA 60079-0,

ANSI/ISA 60079-11, C22.2 No.142, C22.2 No.157, C22.2 No.213, E60079-0, E60079-11, E60079-15.

C-IT.MH04.B.00306 conforms to GOST R IEC 60079-0, GOST R IEC 60079-11, GOST R IEC 60079-15.

CLJ 16.0034 X conforms to DCTY 7113, GOCT 22782.5-78, DCTY IEC 60079-15.

TUV Certificate No. C-IS-236198-02, SIL 2 according to IEC 61511.

DNV No.A-13778 and KR No.MIL20769-EL001 Certificates for maritime applications.

**Mounting:** T35 DIN Rail according to EN50022.

**Weight:** about 160 g.

**Connection:** by polarized plug-in disconnect screw terminal blocks to accommodate terminations up to 2.5 mm<sup>2</sup>.

**Location:** Safe Area/Non Hazardous Locations or Zone 2, Group IIC T4, Class I, Division 2, Groups A, B, C, D Temperature Code T4 and Class I, Zone 2, Group IIC, IIB, IIA T4 installation.

**Protection class:** IP 20.

**Dimensions:** Width 22.5 mm, Depth 99 mm, Height 114.5 mm.


## Ordering information

Model:	D1073S		
Power Bus enclosure		/B	
Reference Junction Compensator (TC input)	OPT1091		

Power Bus and DIN-Rail accessories:  
 DIN rail anchor MCHP065  
 DIN rail stopper MOR016  
 Terminal block male MOR017  
 Terminal block female MOR022


Operating parameters are programmable by the GM Pocket Portable Configurator PPC1090 or via RS-232 serial line with PPC1092 Adapter and SWC1090 Configurator software. If the parameters are provided with the purchasing order the unit will be configured accordingly, otherwise the unit will be supplied with default parameters.  
**NOTE:** for thermocouple sensor input, the Reference Junction Compensator is required for automatic ambient temperature compensation. It has to be ordered as OPT1091, it will be supplied separately and it has to be connected to the input terminal blocks as indicated in the function diagram.

## Front Panel and Features

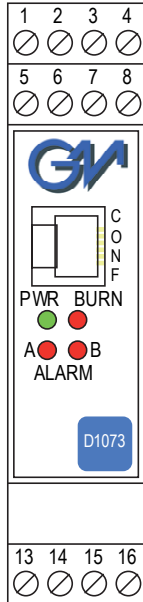

- SIL 2 according to IEC 61511 using analog (current) out for  $T_{proof} = 2 / 10$  years ( $\leq 10\%$  /  $> 10\%$  of total SIF) with PFDavg (1 year)  $3.35 \text{ E-}04$ , SFF 76.12 %
- SIL 2 according to IEC 61511 using trip amplifiers (with NE relay condition) for  $T_{proof} = 3 / 10$  years ( $\leq 10\%$  /  $> 10\%$  of total SIF), with PFDavg (1 year)  $2.86 \text{ E-}04$ , SFF 82.40 %.
- Input from Zone 0 (Zone 20), Division 1, installation in Zone 2, Division 2.
- mV, thermocouples, RTD or transmitting potentiometers Input Signal.
- Programmable RTD line resistance compensation.
- Reference Junction Compensation automatic or fixed (programmable value).
- 0/4-20 mA, 0/1-5 V, 0/2-10 V Output Signal temperature linear or reverse.
- 16 characters tag.
- Two independent trip amplifiers.
- Output for burnout detection.
- Common burnout detection available when using Power Bus enclosure.
- High Accuracy,  $\mu\text{P}$  controlled A/D converter.
- Three port isolation, Input/Output/Supply.
- EMC Compatibility to EN61000-6-2, EN61000-6-4.
- Fully programmable operating parameters.
- ATEX, IECEx, UL & C-UL, FM & FM-C, INMETRO, EAC-EX, UKR TR n. 898, TÜV Certifications.
- TÜV Functional Safety Certification.
- Type Approval Certificate DNV and KR for maritime applications.
- Simplified installation using standard DIN Rail and plug-in terminal blocks.
- 250 Vrms ( $U_m$ ) max. voltage allowed to the instruments associated with the barrier.

## Terminal block connections

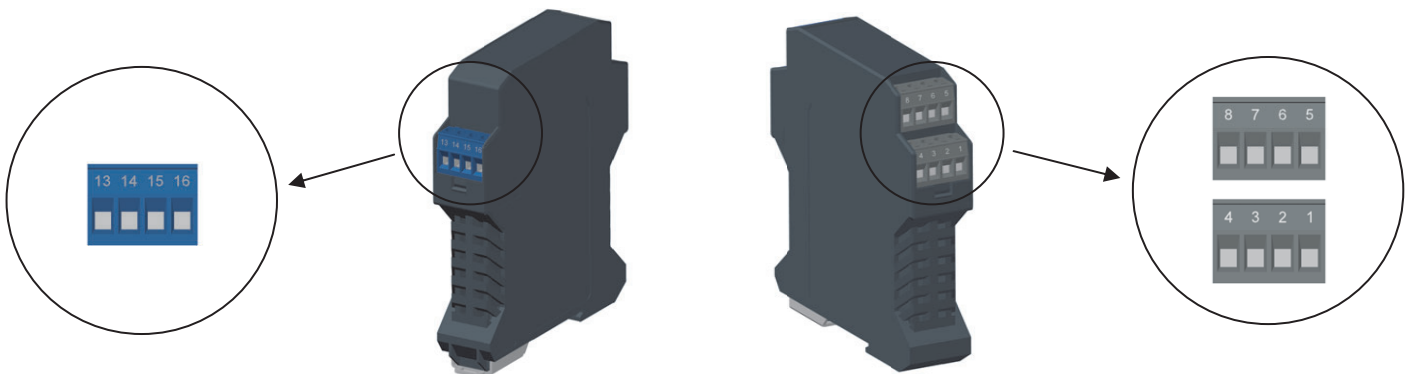

### HAZARDOUS AREA

- |           |   |
|-----------|---|
| <b>13</b> | Input Ch 1 for Reference Junction Compensator Option 91 or Input Ch 1 for 3-4 wire RTD or potentiometer |
| <b>14</b> | Input Ch 1 for 3-4 wire RTD   |
| <b>15</b> | + Input Ch 1 for thermocouple TC or Input Ch 1 for 4 wire RTD or potentiometer                          |
| <b>16</b> | Input Ch 1 for thermocouple TC or Input Ch 1 for 3-4 wire RTD or potentiometer                          |

### SAFE AREA

- |          |  |
|----------|--|
| <b>1</b> | + Output Ch 1 for Current Source mode or + Output Ch 1 for Voltage Source mode |
| <b>2</b> | - Output Ch 1 for Current Source mode or - Output Ch 1 for Voltage Source mode |
| <b>3</b> | + Power Supply 24 Vdc  |
| <b>4</b> | - Power Supply 24 Vdc  |
| <b>5</b> | Alarm A  |
| <b>6</b> | Alarm A  |
| <b>7</b> | Alarm B  |
| <b>8</b> | Alarm B  |

## Parameters Table

In the system safety analysis, always check the Hazardous Area/Hazardous Locations devices to conform with the related system documentation, if the device is Intrinsically Safe check its suitability for the Hazardous Area/Hazardous Locations and gas group encountered and that its maximum allowable voltage, current, power ( $U_i/V_{max}$ ,  $I_i/I_{max}$ ,  $P_i/P_i$ ) are not exceeded by the safety parameters ( $U_o/V_{oc}$ ,  $I_o/I_{sc}$ ,  $P_o/P_o$ ) of the D1073 Associated Apparatus connected to it. Also consider the maximum operating temperature of the field device, check that added connecting cable and field device capacitance and inductance do not exceed the limits ( $C_o/C_a$ ,  $L_o/L_a$ ,  $L_o/R_o$ ) given in the Associated Apparatus parameters for the effective gas group. See parameters on enclosure side and the ones indicated in the table below:

D1073 Terminals		D1073 Associated Apparatus Parameters	Must be	Hazardous Area/ Hazardous Locations Device Parameters
Ch1	13 - 14 - 15 - 16	$U_o / V_{oc} = 10.8 \text{ V}$	$\leq$	$U_i / V_{max}$
Ch1	13 - 14 - 15 - 16	$I_o / I_{sc} = 9 \text{ mA}$	$\leq$	$I_i / I_{max}$
Ch1	13 - 14 - 15 - 16	$P_o / P_o = 24 \text{ mW}$	$\leq$	$P_i / P_i$
D1073 Terminals		D1073 Associated Apparatus Parameters	Must be	Hazardous Area/ Hazardous Locations Device + Cable Parameters
Ch1	13 - 14 - 15 - 16	$C_o / C_a = 2.134 \mu\text{F}$ (IIC-A, B)	$\geq$	$C_i / C_i \text{ device} + C \text{ cable}$
		$C_o / C_a = 14.994 \mu\text{F}$ (IIB-C)		
		$C_o / C_a = 65.994 \mu\text{F}$ (IIA-D)		
		$C_o / C_a = 58 \mu\text{F}$ (I)		
		$C_o / C_a = 14.994 \mu\text{F}$ (IIIC)		
Ch1	13 - 14 - 15 - 16	$L_o / L_a = 468 \text{ mH}$ (IIC-A, B)	$\geq$	$L_i / L_i \text{ device} + L \text{ cable}$
		$L_o / L_a = 1874 \text{ mH}$ (IIB-C)		
		$L_o / L_a = 3749 \text{ mH}$ (IIA-D)		
		$L_o / L_a = 6100 \text{ mH}$ (I)		
		$L_o / L_a = 1874 \text{ mH}$ (IIIC)		
Ch1	13 - 14 - 15 - 16	$L_o / R_o = 1510 \mu\text{H}/\Omega$ (IIC-A, B)	$\geq$	$L_i / R_i \text{ device and}$ $L \text{ cable} / R \text{ cable}$
		$L_o / R_o = 6050 \mu\text{H}/\Omega$ (IIB-C)		
		$L_o / R_o = 12100 \mu\text{H}/\Omega$ (IIA-D)		
		$L_o / R_o = 19850 \mu\text{H}/\Omega$ (I)		
		$L_o / R_o = 6050 \mu\text{H}/\Omega$ (IIIC)		

NOTE for USA and Canada:  
 IIC equal to Gas Groups A, B, C, D, E, F and G  
 IIB equal to Gas Groups C, D, E, F and G  
 IIA equal to Gas Groups D, E, F and G

When used with separate powered intrinsically safe devices, check that maximum allowable voltage ( $U_i/V_{max}$ ) of the D1073 Associated Apparatus are not exceeded by the safety parameters ( $U_o/V_{oc}$ ) of the Intrinsically Safe device, indicated in the table below:

D1073 Terminals		D1073 Associated Apparatus Parameters	Must be	Hazardous Area/ Hazardous Locations Device Parameters
Ch1	13 - 14 - 15 - 16	$U_i / V_{max} = 18 \text{ V}$	$\geq$	$U_o / V_{oc}$
Ch1	13 - 14 - 15 - 16	$C_i = 6 \text{ nF}$ , $L_i = 0 \text{ nH}$		

**For installations in which both the  $C_i$  and  $L_i$  of the Intrinsically Safe apparatus exceed 1 % of the  $C_o$  and  $L_o$  parameters of the Associated Apparatus (excluding the cable), then 50 % of  $C_o$  and  $L_o$  parameters are applicable and shall not be exceeded (50 % of the  $C_o$  and  $L_o$  become the limits which must include the cable such that  $C_i \text{ device} + C \text{ cable} \leq 50 \% \text{ of } C_o$  and  $L_i \text{ device} + L \text{ cable} \leq 50 \% \text{ of } L_o$ ).**

If the cable parameters are unknown, the following value may be used: Capacitance 60pF per foot (180pF per meter), inductance 0.20μH per foot (0.60μH per meter).

The Intrinsic Safety Entity Concept allows the interconnection of Intrinsically Safe devices approved with entity parameters not specifically examined in combination as a system when the above conditions are respected.

For Division 1 and Zone 0 installations, the configuration of Intrinsically Safe Equipment must be FM approved under Entity Concept (or third party approved);


for Division 2 installations, the configuration of Intrinsically Safe Equipment must be FM approved under non-incendive field wiring or Entity Concept (or third party approved).

## Function Diagram


HAZARDOUS AREA ZONE 0 (ZONE 20) GROUP IIC,  
HAZARDOUS LOCATIONS CLASS I, DIVISION 1, GROUPS A, B, C, D,  
CLASS II, DIVISION 1, GROUPS E, F, G, CLASS III, DIVISION 1,  
CLASS I, ZONE 0, GROUP IIC

SAFE AREA, ZONE 2 GROUP IIC T4,  
NON HAZARDOUS LOCATIONS, CLASS I, DIVISION 2,  
GROUPS A, B, C, D T-Code T4, CLASS I, ZONE 2, GROUP IIC T4

MODEL D1073S

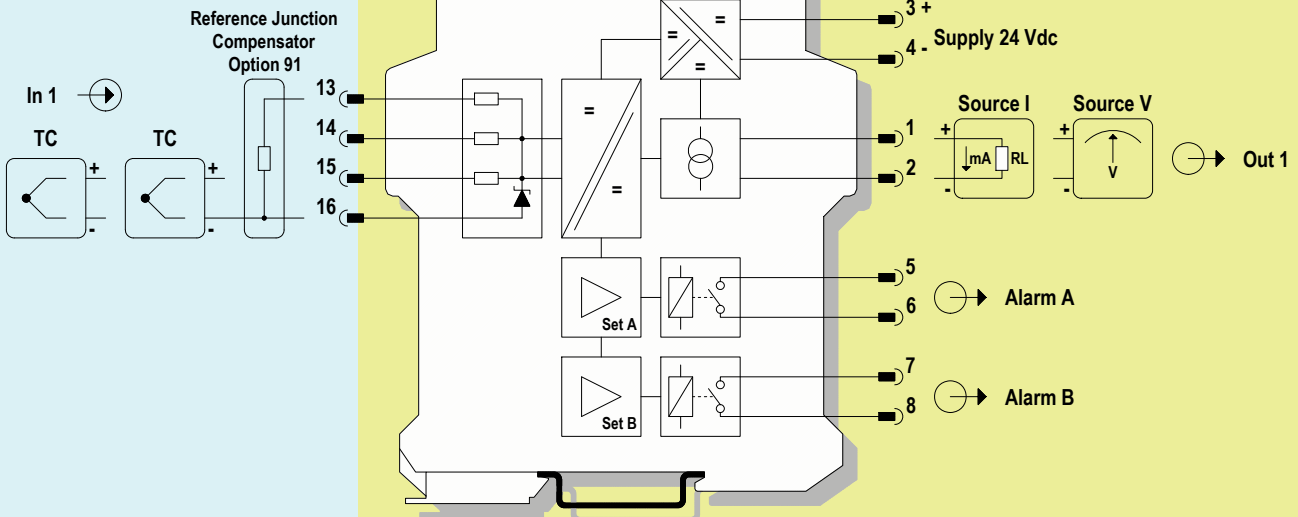


MODEL D1073S

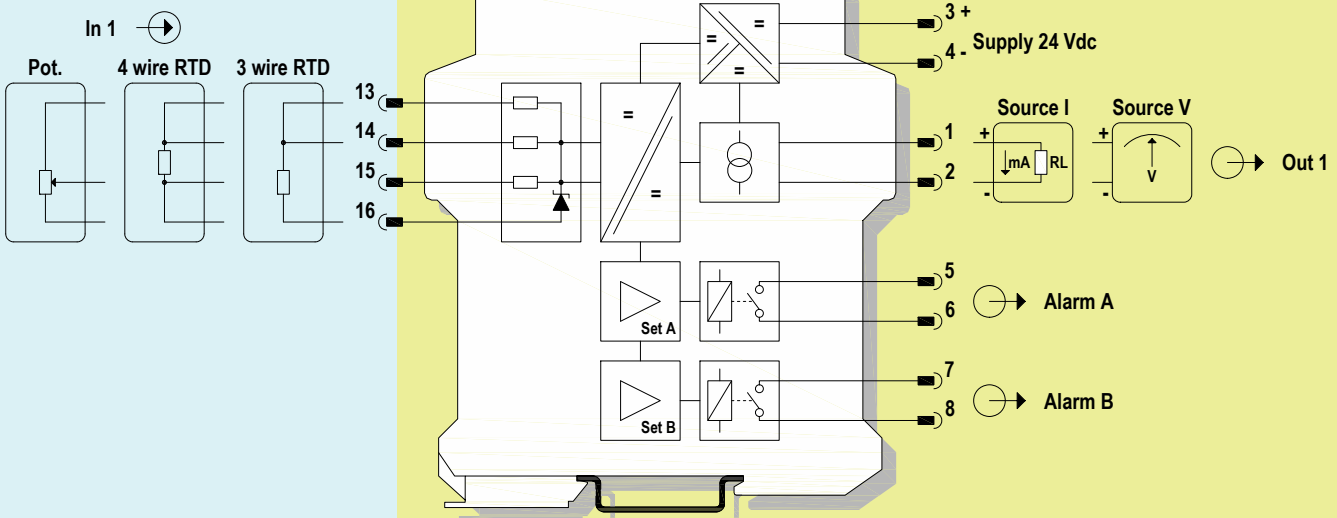

**For SIL applications, alarm contacts must be used in series with equal configuration. Relay contact shown in de-energized position**

Application for D1073S , with 4-20 mA Analog Current Output

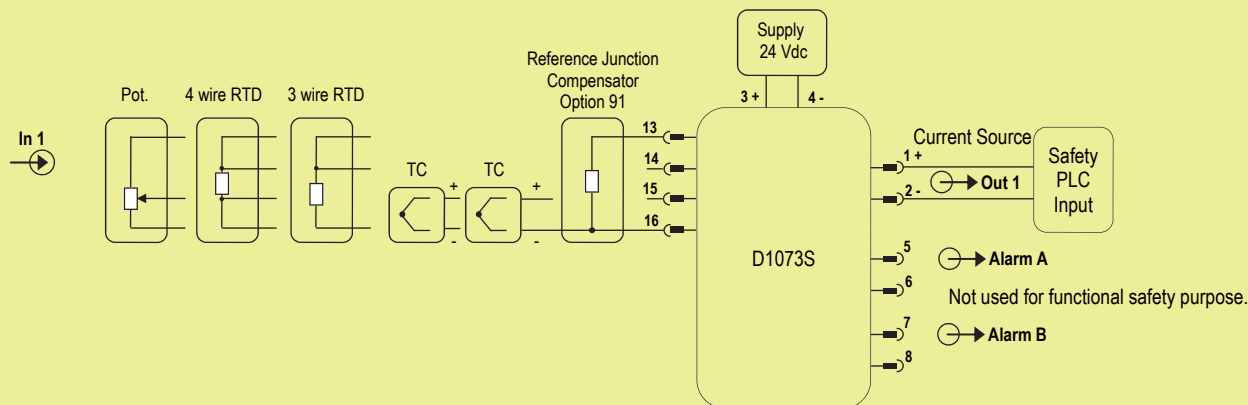

**Description:**

For this application, enable 4 - 20 mA Source mode (see page 11 for more information).  
 The module is powered by connecting 24 Vdc power supply to Pins 3 (+ positive) and 4 (- negative). The green LED is lit in presence of supply power.  
 Input sensor (Thermocouple, RTD, Potentiometer) is applied from Pins 13 to 16 (see page 12 for more information about input settings).  
 Source output current is applied to Pins 1-2. Alarm A and Alarm B Outputs are not used for functional safety purpose.

**Safety Function and Failure behavior:**

- D1073S is considered to be operating in Low Demand mode, as a Type B module, having Hardware Fault Tolerance (HFT) = 0.  
 The failure behaviour of D1073S module (only the 4 - 20 mA current output configuration is used for functional safety application) is described from the following definitions :
- Fail-Safe State: is defined as the output going Low or High, considering that the safety logic solver can convert the Low or High fail (dangerous detected) to the fail-safe state.
  - Fail Safe: failure mode that causes the module / (sub)system to go to the defined fail-safe state without a demand from the process.
  - Fail Dangerous: failure mode that does not respond to a demand from the process (i.e. being unable to go to the defined fail-safe state) or deviates the output current by more than 3 % ( $\pm 0.5$  mA) of full span.
  - Fail High: failure mode that causes the output signal to go above the maximum output current (> 20 mA). This limit value can be programmed from the user, but in this analysis it is set to 20 mA. Assuming that the application program in the safety logic solver is configured to detect High failure and does not automatically trip on this failure, this failure has been classified as a dangerous detected (DD) failure.
  - Fail Low: failure mode that causes the output signal to go below the minimum output current (< 4 mA). This limit value can be programmed from the user, but in this analysis it is set to 4 mA. Assuming that the application program in the safety logic solver is configured to detect Low failure and does not automatically trip on this failure, this failure has been classified as a dangerous detected (DD) failure.
  - Fail "No Effect": failure mode of a component that plays a part in implementing the safety function but that is neither a safe failure nor a dangerous failure. When calculating the SFF, this failure mode is not taken into account.
  - Fail "Not part": failure mode of a component which is not part of the safety function but part of the circuit diagram and is listed for completeness. When calculating the SFF this failure mode is not taken into account.

As the module is supposed to be proven-in-use device, therefore according to the requirements of IEC 61511-1 section 11.4.4, a HFT = 0 is sufficient for SIL 2 (sub-) systems including Type B components and having a SFF equal or more than 60% and less than 90%.

Failure rate date: taken from Siemens Standard SN29500.

**Failure rate table:**

Failure category	Failure rates (FIT)
$\lambda_{dd}$ = Total Dangerous Detected failures	242.35
$\lambda_{du}$ = Total Dangerous Undetected failures	76.01
$\lambda_{sd}$ = Total Safe Detected failures	0.00
$\lambda_{su}$ = Total Safe Undetected failures	0.00
<b><math>\lambda_{tot\ safe}</math> = Total Failure Rate (Safety Function) = <math>\lambda_{dd} + \lambda_{du} + \lambda_{sd} + \lambda_{su}</math></b>	<b>318.36</b>
<b>MTBF (safety function, single channel) = <math>(1 / \lambda_{tot\ safe}) + MTTR</math> (8 hours)</b>	<b>358 years</b>
$\lambda_{no\ effect}$ = "No Effect" failures	154.04
$\lambda_{not\ part}$ = "Not Part" failures	31.40
<b><math>\lambda_{tot\ device}</math> = Total Failure Rate (Device) = <math>\lambda_{tot\ safe} + \lambda_{no\ effect} + \lambda_{not\ part}</math></b>	<b>503.80</b>
<b>MTBF (device, single channel) = <math>(1 / \lambda_{tot\ device}) + MTTR</math> (8 hours)</b>	<b>226 years</b>

**Failure rates table according to IEC 61508:2010 Ed.2 :**

$\lambda_{sd}$	$\lambda_{su}$	$\lambda_{dd}$	$\lambda_{du}$	SFF	DC <sub>s</sub>	DC <sub>D</sub>
0.00 FIT	0.00 FIT	242.35 FIT	76.01 FIT	76.12%	0%	76.12%


where DC means the diagnostic coverage (safe or dangerous) for the input sensor by the safety logic solver and internal diagnostic circuits. This type "B" system has SFF = 76.12 %  $\geq$  60 % and HFT = 0, which is sufficient to get SIL 2 in accordance with the requirements of IEC 61511-1 section 11.4.4 during a proven-in-use assessment.

**PFDavg vs T[Proof] table** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $\leq$ 10% of total SIF dangerous failures:

T[Proof] = 1 year	T[Proof] = 2 years
PFDavg = 3.35E-04 Valid for SIL 2	PFDavg = 6.70E-04 Valid for SIL 2

**PFDavg vs T[Proof] table** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes >10% of total SIF dangerous failures:

T[Proof] = 10 years
PFDavg = 3.35E-03 Valid for SIL 2

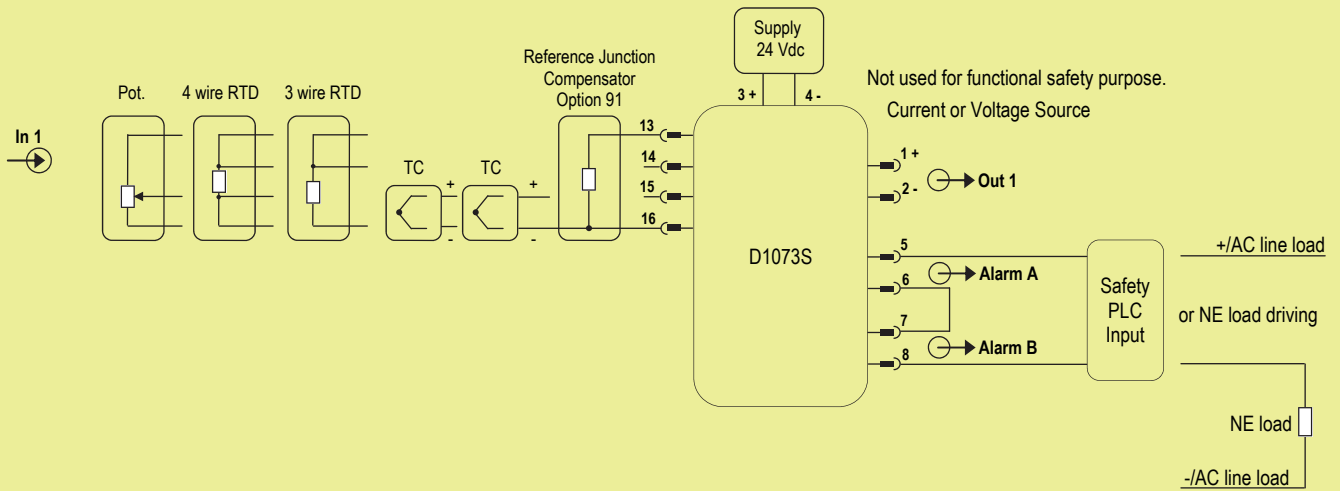

**Description:**

For this application, enable both alarm A and B trip amplifiers programmed with equal configuration, using NE relay condition (see page 11 for more information). The module is powered by connecting 24 Vdc power supply to Pins 3 (+ positive) and 4 (- negative). The green LED is lit in presence of supply power. Input sensor (Thermocouple, RTD, Potentiometer) is applied from Pins 13 to 16 (see page 12 for more information about input settings). Relay contacts of Alarm A and Alarm B Outputs must be connected in series: Pins 6-7 are connected together by external wired jumper. Therefore between Pins 5-8 there are 2 relay contacts in 1oo2 series architecture which could be connected to safety PLC input or used to driving a NE load. In this case, relays are normally energized, their contacts are closed and load is normally energized; in case of alarm, the system de-energized to trip, so that relays are de-energized, contacts are open and load is de-energized. To prevent relay contacts from damaging, connect an external protection (fuse or similar), chosen according to the relay breaking capacity (see page 2 for relay contact rating). Analog (current or voltage) output is not used for functional safety purpose.

**Safety Function and Failure behavior:**

D1073S is considered to be operating in Low Demand mode, as a Type B module, having Hardware Fault Tolerance (HFT) = 0. The failure behaviour of D1073S module (only Alarm A and Alarm B trip amplifiers is used for safety applications) is described from the following definitions :

- Fail-Safe State: it's defined as the relay output being de-energized or relay contacts remaining open (the user can programme the trip point value at which relay output must be de-energized).
- Fail Safe: failure mode that causes the module / (sub)system to go to the defined fail-safe state without a demand from the process.
- Fail Dangerous: failure mode that leads to a measurement error of more than 3 % of correct value and therefore has the potential to not respond to a demand from the process (i.e. being unable to go to the defined fail-safe state), so that the relay contacts remain closed.
- Fail "No Effect": failure mode of a component that plays a part in implementing the safety function but that is neither a safe failure nor a dangerous failure. When calculating the SFF, this failure mode is not taken into account.
- Fail "Not part": failure mode of a component which is not part of the safety function but part of the circuit diagram and is listed for completeness. When calculating the SFF this failure mode is not taken into account.

Both alarm A and B trip amplifiers must be programmed with equal configuration (the same trip values).  
Failure rate date: taken from Siemens Standard SN29500.

**Failure rate table:**

Failure category	Failure rates (FIT)
$\lambda_{dd}$ = Total Dangerous Detected failures	0.00
$\lambda_{du}$ = Total Dangerous Undetected failures	65.13
$\lambda_{sd}$ = Total Safe Detected failures	0.00
$\lambda_{su}$ = Total Safe Undetected failures	304.97
<b><math>\lambda_{tot\ safe}</math> = Total Failure Rate (Safety Function) = <math>\lambda_{dd} + \lambda_{du} + \lambda_{sd} + \lambda_{su}</math></b>	<b>370.10</b>
<b>MTBF (safety function, single channel) = <math>(1 / \lambda_{tot\ safe}) + MTTR</math> (8 hours)</b>	<b>308 years</b>
$\lambda_{no\ effect}$ = "No Effect" failures	204.10
$\lambda_{not\ part}$ = "Not Part" failures	145.80
<b><math>\lambda_{tot\ device}</math> = Total Failure Rate (Device) = <math>\lambda_{tot\ safe} + \lambda_{no\ effect} + \lambda_{not\ part}</math></b>	<b>720.00</b>
<b>MTBF (device, single channel) = <math>(1 / \lambda_{tot\ device}) + MTTR</math> (8 hours)</b>	<b>158 years</b>

**Failure rates table according to IEC 61508:2010 Ed.2 :**

$\lambda_{sd}$	$\lambda_{su}$	$\lambda_{dd}$	$\lambda_{du}$	SFF
0.00 FIT	304.97 FIT	0.00 FIT	65.13 FIT	82.40%

This type "B" system has SFF = 82.40 %  $\geq$  60 % and HFT = 0, which is sufficient to get SIL 2 in accordance with the requirements of IEC 61511-1 section 11.4.4 during a proven-in-use assessment.

**PFDavg vs T[Proof] table** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $\leq$ 10% of total SIF dangerous failures:

T[Proof] = 1 year	T[Proof] = 3 years
PFDavg = 2.86 E-04 Valid for SIL 2	PFDavg = 8.58 E-04 Valid for SIL 2

**PFDavg vs T[Proof] table** (assuming Proof Test coverage of 99%), with determination of SIL supposing module contributes  $>$ 10% of total SIF dangerous failures:

T[Proof] = 10 years
PFDavg = 2.86 E-03 Valid for SIL 2

## Testing procedure at T-proof

The proof test shall be performed to reveal dangerous faults which are undetected by diagnostic. This means that it is necessary to specify how dangerous undetected fault, which have been noted during the FMEDA, can be detected during the proof test.

### Test for D1073S (analog current output):

#### Proof test 1 (to reveal approximately 50 % of possible Dangerous Undetected failures)

Steps	Action
1	Bypass the safety PLC or take other appropriate action to avoid a false trip.
2	Send a command to the temperature converter to go to the full scale current output and verify that the analog current reaches that value. This tests for compliance voltage problems such as a low loop power supply voltage or increased wiring resistance. This also tests for other possible failures.
3	Send a command to the temperature converter to go to the low scale current output and verify that the analog current reaches that value. This tests for possible quiescent current related failures.
4	Restore the loop to full operation.
5	Remove the bypass from the safety-related PLC or otherwise restore normal operation.

#### Proof test 2 (to reveal approximately 99 % of possible Dangerous Undetected failures)

Steps	Action
1	Bypass the safety PLC or take other appropriate action to avoid a false trip.
2	Perform steps 2 and 3 of <b>Proof Test 1</b> .
3	Perform a two-point calibration of the temperature converter (i.e. 4 mA and 20 mA) and verify that the output current from the module is within the specified accuracy.
4	Restore the loop to full operation.
5	Remove the bypass from the safety-related PLC or otherwise restore normal operation.

### Test for D1073S (alarm trip amplifiers: two relay outputs in series):

#### Proof test 1 (to reveal approximately 50 % of possible Dangerous Undetected failures)

Steps	Action
1	Bypass the safety PLC or take other appropriate action to avoid a false trip.
2	Send a command to the temperature converter to go to the high alarm current output and verify that the relay contacts (between terminal blocks 5-8) trip.
3	Send a command to the temperature converter to go to the low alarm current output and verify that the relay contacts (between terminal blocks 5-8) trip.
4	Restore the loop to full operation.
5	Remove the bypass from the safety-related PLC or otherwise restore normal operation.

#### Proof test 2 (to reveal approximately 90 % of possible Dangerous Undetected failures)

Steps	Action
1	Bypass the safety PLC or take other appropriate action to avoid a false trip.
2	Performs step 2 and 3 of <b>Proof Test 1</b> .
3	Perform a two-point calibration of the temperature trip amplifier (i.e. 4 mA and 20 mA) and verify that the relay contacts between terminal blocks 5-8) trip.
4	Restore the loop to full operation.
5	Remove the bypass from the safety-related PLC or otherwise restore normal operation.

#### Proof test 3 (to reveal approximately 99 % of possible Dangerous Undetected failures)

Steps	Action
1	Bypass the safety PLC or take other appropriate action to avoid a false trip.
2	Remove the jumper between terminal blocks 6-7.
3	Perform a two-point calibration of the temperature trip amplifier (i.e. 4 mA and 20 mA) and verify that the relay contacts (between terminal blocks 5-6) trip.
4	Perform a two-point calibration of the temperature trip amplifier (i.e. 4 mA and 20 mA) and verify that the relay contacts (between terminal blocks 7-8) trip.
5	Restore the jumper between terminal blocks 6-7.
6	Restore the loop to full operation.
7	Remove the bypass from the safety-related PLC or otherwise restore normal operation.

## Installation

D1073 is a temperature signal converter and trip amplifiers housed in a plastic enclosure suitable for installation on T35 DIN Rail according to EN50022.

D1073 unit can be mounted with any orientation over the entire ambient temperature range, see section "Installation in Cabinet" and "Installation of Electronic Equipments in Cabinet" Instruction Manual D1000 series for detailed instructions.

D1073 temperature signal converter operates at low level measuring signals, for best performance, install it far from heat sources (heat dissipating equipment) and wide temperature excursions, in example at the bottom of a cabinet with heat dissipating equipment, if any, at the top.

Electrical connection of conductors up to 2.5 mm<sup>2</sup> are accommodated by polarized plug-in removable screw terminal blocks which can be plugged in/out into a powered unit without suffering or causing any damage (**for Zone 2 or Division 2 installations check the area to be nonhazardous before servicing**).

The wiring cables have to be proportionate in base to the current and the length of the cable.

On the section "Function Diagram" and enclosure side a block diagram identifies all connections.

Identify the function and location of each connection terminal using the wiring diagram on the corresponding section, as an example:

Connect 24 Vdc power supply positive at terminal "3" and negative at terminal "4".

Connect positive output of analog channel at terminal "1" and negative output at "2".

Connect trip amplifier output of alarm A at terminal "5" and "6" and trip amplifier output of alarm B at terminal "7" and "8".

For a thermocouple temperature input, connect thermocouple positive extension wire at terminal "15", negative and shield (if any) at terminal "16".

Make sure that compensating wires have the correct metal and thermal e.m.f. and are connected to the appropriate thermocouple terminal, note that a wrong compensating cable type or a swapped connection is not immediately apparent but introduces a misleading measurement error that appears as a temperature drift. For a 3 wires thermoresistance temperature input connect thermometer wire A at terminal "16", B and C interconnected wires at "14" and "13".

Note that for a correct line resistance compensation in case of 3 wire sensor, wire A and B should have the same resistance.

Intrinsically Safe conductors must be identified and segregated from non I.S. and wired in accordance to the relevant national/international installation standards (e.g. EN/IEC60079-15 Electrical apparatus for explosive gas atmospheres - Part 14: Electrical installations in hazardous areas (other than mines), BS 5345 Pt4, VDE 165, ANSI/ISA RP12.06.01 Installation of Intrinsically Safe System for Hazardous (Classified) Locations, National Electrical Code NEC ANSI/NFPA 70 Section 504 and 505, Canadian Electrical Code CEC), make sure that conductors are well isolated from each other and do not produce any unintentional connection.

Connect SPST alarm contacts checking the load rating to be within the contact maximum rating (2 A, 250 V, 500 VA 80 W resistive load).

The enclosure provides, according to EN60529, an IP20 minimum degree of mechanical protection (or similar to NEMA Standard 250 type 1) for indoor installation, outdoor installation requires an additional enclosure with higher degree of protection (i.e. IP54 to IP65 or NEMA type 12-13) consistent with the effective operating environment of the specific installation. Units must be protected against dirt, dust, extreme mechanical (e.g. vibration, impact and shock) and thermal stress, and casual contacts.

If enclosure needs to be cleaned use only a cloth lightly moistened by a mixture of detergent in water.

**Electrostatic Hazard: to avoid electrostatic hazard, the enclosure of D1073 must be cleaned only with a damp or antistatic cloth.**


Any penetration of cleaning liquid must be avoided to prevent damage to the unit. Any unauthorized card modification must be avoided. According to EN61010, D1073 series must be connected to SELV or SELV-E supplies. Relay output contact must be connected to loads non exceeding category I, pollution degree I overvoltage limits.

**Warning: de-energize main power source (turn off power supply voltage) and disconnect plug-in terminal blocks before opening the enclosure to avoid electrical shock when connected to live hazardous potential.**



## Warning

D1073 is an isolated Intrinsically Safe Associated Apparatus installed into standard EN50022 T35 DIN Rail located in Safe Area/Non Hazardous Locations or Zone 2, Group IIC, Temperature Classification T4, Class I, Division 2, Groups A, B, C, D, Temperature Code T4 and Class I, Zone 2, Group IIC, IIB, IIA Temperature Code T4 Hazardous Area/Hazardous Locations (according to EN/IEC60079-15, FM Class No. 3611, CSA-C22.2 No. 213-M1987, CSA-E60079-15) within the specified operating temperature limits Tamb -20 to +60 °C, and connected to equipment with a maximum limit for AC power supply Um of 250 Vrms.

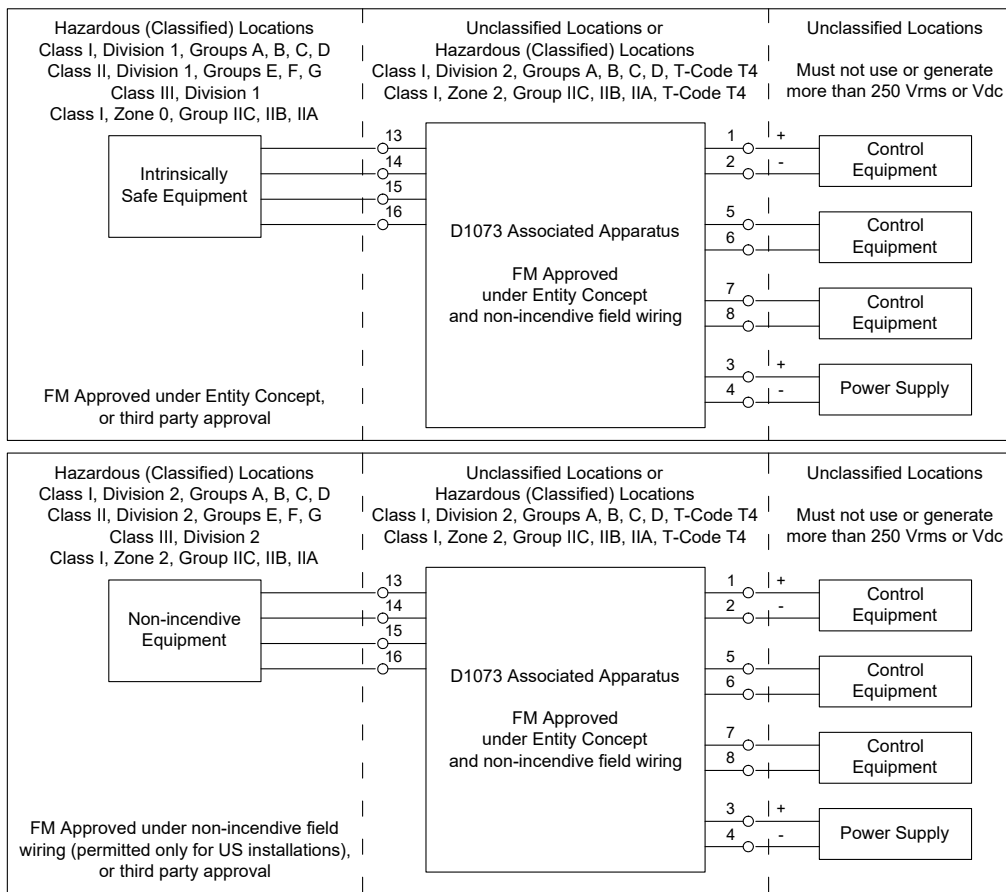

Non-incendive field wiring is not recognized by the Canadian Electrical Code, installation is permitted in the US only.

For installation of the unit in a Class I, Division 2 or Class I, Zone 2 location, the wiring between the control equipment and the D1073 associated apparatus shall be accomplished via conduit connections or another acceptable Division 2, Zone 2 wiring method according to the NEC and the CEC.

Not to be connected to control equipment that uses or generates more than 250 Vrms or Vdc with respect to earth ground.

D1073 must be installed, operated and maintained only by qualified personnel, in accordance to the relevant national/international installation standards

(e.g. IEC/EN60079-15 Electrical apparatus for explosive gas atmospheres - Part 14: Electrical installations in hazardous areas (other than mines), BS 5345 Pt4, VDE 165,

ANSI/ISA RP12.06.01 Installation of Intrinsically Safe System for Hazardous (Classified) Locations, National Electrical Code NEC ANSI/NFPA 70 Section 504 and 505,

Canadian Electrical Code CEC) following the established installation rules, particular care shall be given to segregation and clear identification of I.S. conductors from non I.S. ones.

De-energize power source (turn off power supply voltage) before plug or unplug the terminal blocks when installed in Hazardous Area/Hazardous Locations or

unless area is known to be nonhazardous. **Warning: substitution of components may impair Intrinsic Safety and suitability for Division 2, Zone 2.**

**Warning: de-energize main power source (turn off power supply voltage) and disconnect plug-in terminal blocks before opening the enclosure to avoid electrical shock when connected to live hazardous potential.**

**Explosion Hazard: to prevent ignition of flammable or combustible atmospheres, disconnect power before servicing or unless area is known to be nonhazardous.**

Failure to properly installation or use of the equipment may risk to damage the unit or severe personal injury.

The unit cannot be repaired by the end user and must be returned to the manufacturer or his authorized representative. Any unauthorized modification must be avoided.

## Operation

Input channel of D1073 accepts a signal from Hazardous Area/Hazardous Locations (thermocouple, resistance thermometer, transmitting potentiometer) and converts the signal to a 0/4-20 mA or 0/1-5 V or 0/2-10 V floating output to drive a load in Safe Area/Non Hazardous Locations. In addition to the analog output the barrier has also a two channel trip amplifiers providing two relay SPST contacts, alarm A and B, that can be configured as HIGH, LOW, LOW start-up, BURNOUT alarm operating mode and NE or ND relay operating mode. Presence of supply power is displayed by a green signaling LED, status of alarm output A and B is displayed by two red LED, integrity of field sensor and connecting line can be monitored by a configurable burnout circuit which, if enabled, can drive output signal to upscale or downscale limit. Burnout detection is also signaled by a red LED on the front panel and by an optocoupled transistor in common with power supply.

## Start-up

Before powering the unit check that all wires are properly connected, particularly supply conductors and their polarity, input and output wires, also check that Intrinsically Safe conductors and cable trays are segregated (no direct contacts with other non I.S. conductors) and identified either by color coding, preferably blue, or by marking. Check conductors for exposed wires that could touch each other causing dangerous unwanted shorts. Turn on power, the "power on" green led must be lit, output signal should be corresponding to the input from the sensor, alarm LED should reflect the input variable condition with respect to trip points setting. If possible change the transmitter output and check the corresponding Safe Area output.


The Pocket Portable Configurator type PPC1090 is suitable to configure the "smart" barrier of D1000 series. The PPC1090 unit is not ATEX, UL or FM approved and is only to be used in Safe Area/Non Hazardous Locations and prior to installation of the isolator and prior to connection of any I.S. wiring. Do not use PPC1090 configurator in Hazardous Area/Hazardous Locations. The PPC1090 configurator is powered by the unit (no battery power) when the telephone jack is plugged into the barrier (RJ12 6 poles connection type with 1:1 connection). It has a 5 digit display, 4 leds and four push buttons with a menu driven configuration software and can be used in Safe Area/Non Hazardous Locations without any certification because it plugs into the non intrinsically safe portion of circuit.

PPC1090 Configuration

The configuration procedure follows a unit specific menu. The display shows the actual menu item, the led shows the channel configured and the push button actuates as "Enter", "Select", "Down" and "Up" key. The "Enter" key is pressed to confirm the menu item, the "Select" key is pressed to scroll the menu item, the "Down" and "Up" keys are pressed to decrement or increment the numeric value of menu item. The "Up" key is also pressed to decrement the menu level. When the PPC1090 is plugged into the unit, the display shows the barrier model (first level menu). Then press the "Enter" key to the second level menu and the "Select" key to scroll the menu voice. When the selected menu item is displayed press the "Enter" key to confirm the choice. Follow this procedure for every voice of the menu. When a numeric menu item is to be changed, press the "Select" key to highlight the character and then the "Up" and "Down" keys to select the number; confirm the modification with the "Enter" key. To return to a higher level menu press the "Up" key.

D1073S Menu

Menu item description


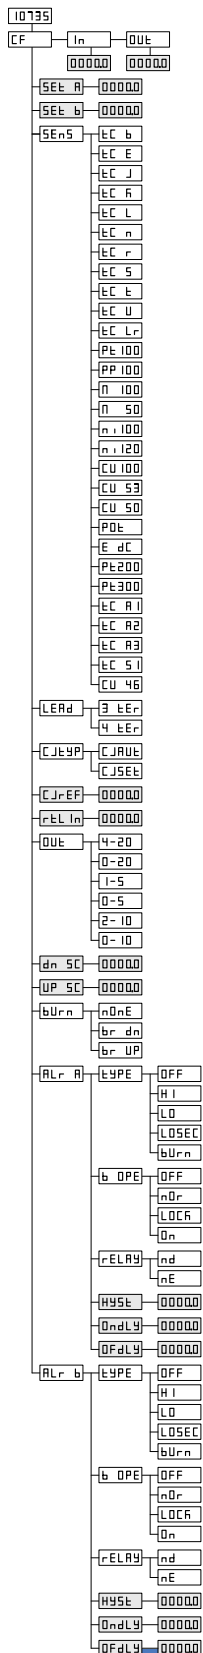


- 1) **D1073S** [1 Level Menu]  
Displays Model D1073S single channel temperature signal converter and trip amplifiers. Press "Enter" key to second level menu.
- 2) **CF** [2 Level Menu]  
Displays the parameters configuration menu. Press "Enter" key to configure the functional parameters, press the "Select" key to the next menu level item or "Up" key to return to first level.
- 3) **In** [2 Level Menu]  
Displays the input variable monitoring. Press "Enter" to display the current input value reading, press the "Select" key to the next menu level item or "Up" key to return to first level.
- 4) **Out** [2 Level Menu]  
Displays the analog output variable monitoring. Press "Enter" to display the current output value reading, press the "Select" key to the next menu level item or "Up" key to return to first level.
- 5) **Set A** [3 Level Menu]  
Displays the SET A Trip Point Value configuration. Press "Enter" to set the trip point value, press the "Select" key to the next menu level item or "Up" key to return to second level. If you pressed "Enter" key, you can set the set value; press the "Select" key to highlight the character you want to change and then the "Up" and "Down" keys to select the number; confirm the modification with the "Enter" key
- 6) **Set B** [3 Level Menu]  
Displays the SET B Trip Point Value configuration. Press "Enter" to set the trip point value, press the "Select" key to the next menu level item or "Up" key to return to second level. If you pressed "Enter" key, you can set the set value; press the "Select" key to highlight the character you want to change and then the "Up" and "Down" keys to select the number; confirm the modification with the "Enter" key
- 7) **Sens** [3 Level Menu]  
Displays the input sensor type configuration. Press "Enter" to set the input sensor, press the "Select" key to the next menu level item or "Up" key to return to second level. If you pressed "Enter" key, you can choose between 26 different sensors; press "Select" key to change the input sensor and then the "Enter" key to confirm the choice. The input sensors are:  
  - Tc B Thermocouple type B, -10 to +1800°C range
  - Tc E Thermocouple type E, -250 to +1000°C range
  - Tc J Thermocouple type J, -200 to +750°C range
  - Tc K Thermocouple type K, -250 to +1350°C range
  - Tc L Thermocouple type L, -200 to +800°C range
  - Tc N Thermocouple type N, -200 to +1300°C range
  - Tc R Thermocouple type R, -50 to +1750°C range
  - Tc S Thermocouple type S, -50 to +1750°C range
  - Tc T Thermocouple type T, -250 to +400°C range
  - Tc U Thermocouple type U, -200 to +400°C range
  - Tc LR Thermocouple type LR (russian standard), -200 to +800°C range
  - Pt 100 Thermoresistance Pt 100 Ω with 0.385 coefficient, -200 to +850°C range
  - PP 100 Thermoresistance Pt 100 Ω with 0.392 coefficient, -200 to +625°C range
  - M 100 Thermoresistance Pt 100 Ω with 0.391 coefficient (russian standard), -200 to +650°C range
  - M 50 Thermoresistance Pt 50 Ω with 0.391 coefficient (russian standard), -200 to +650°C range
  - Ni 100 Thermoresistance Ni 100 Ω, -50 to +180°C range
  - Ni 120 Thermoresistance Ni 120 Ω, (russian standard), -75 to +300°C range
  - CU 100 Thermoresistance Copper 100 Ω (russian standard), -50 to +200°C range
  - CU 53 Thermoresistance Copper 53 Ω (russian standard), -50 to +180°C range
  - CU 50 Thermoresistance Copper 50 Ω (russian standard), -50 to +200°C range
  - Pot Potentiometer, 0 to 100% range
  - E dc mV dc input from externally powered transmitter, -20 to +85mV range
  - Pt 200 Thermoresistance Pt 200 Ω with 0.385 coefficient, -150 to +400°C range
  - Pt 300 Thermoresistance Pt 300 Ω with 0.385 coefficient, -150 to +250°C range
  - Tc A1 Thermocouple type A1 (russian standard), -10 to +2500°C range
  - Tc A2 Thermocouple type A2 (russian standard), -10 to +1800°C range
  - Tc A3 Thermocouple type A3 (russian standard), -10 to +1800°C range
  - Tc S1 Thermocouple type S (russian standard), -50 to +1600°C range
  - CU 46 Thermoresistance Copper 46 Ω (russian standard), -200 to +650°C range
- 8) **Lead** [3 Level Menu]  
Displays the input sensor connection type configuration for thermoresistance sensor. Press "Enter" to set the input connection type, press the "Select" key to the next menu level item or "Up" key to return to second level. If you pressed "Enter" key, you can choose between 2 different sensor connection; press "Select" key to change the input connection and then the "Enter" key to confirm the choice. The input connection types are:  
  - 3 ter 3 wire connection type thermoresistance
  - 4 ter 4 wire connection type thermoresistance
- 9) **CJ Typ** [3 Level Menu]  
Displays the reference junction compensation type configuration for thermocouple sensor. Press "Enter" to set the input compensation type, press the "Select" key to the next menu level item or "Up" key to return to second level. If you pressed "Enter" key, you can choose between 2 different sensor compensation types; press "Select" key to change the type and then the "Enter" key to confirm the choice.  

The input compensation types are:

  - CJ Aut automatic compensation of ambient temperature (via option 91 thermoresistance sensor)
  - CJ Set fixed ambient temperature compensation, value is settled by CJ Ref menu item (do not require option 91 thermoresistance sensor)

- 10) **CJ Ref** [3 Level Menu]  
Displays the ambient temperature compensation value configuration for thermocouple sensor. Press "Enter" to set the value, press the "Select" key to the next menu level item or "Up" key to return to second level. If you pressed "Enter" key, you can set the compensation value; press the "Select" key to highlight the character you want to change and then the "Up" and "Down" keys to select the number; confirm the modification with the "Enter" key. The value is settable from -60 to +100 °C
- 11) **Rt Lin** [3 Level Menu]  
Displays the thermoresistance compensation value configuration for thermoresistance sensor. Press "Enter" to set the value, press the "Select" key to the next menu level item or "Up" key to return to second level. If you pressed "Enter" key, you can set the compensation value; press the "Select" key to highlight the character you want to change and then the "Up" and "Down" keys to select the number; confirm the modification with the "Enter" key. The value is settable from -5 to +20 Ω
- 12) **Out** [3 Level Menu]  
Displays the analog output type configuration. Press "Enter" to set the analog output type and range, press the "Select" key to the next menu level item or "Up" key to return to second level. If you pressed "Enter" key, you can choose between 6 different output types; press "Select" key to change the output type and range and then the "Enter" key to confirm the choice. The output types are:  
4-20 4 to 20 mA current output (for SIL applications)  
0-20 0 to 20 mA current output  
1-5 1 to 5 V voltage output  
0-5 0 to 5 V voltage output  
2-10 2 to 10 V voltage output  
0-10 0 to 10 V voltage output
- 13) **Dn Sc** [3 Level Menu]  
Displays the input low scale configuration. Press "Enter" to set the low scale input value, press the "Select" key to the next menu level item or "Up" key to return to second level. If you pressed "Enter" key, you can set the low input value; press the "Select" key to highlight the character you want to change and then the "Up" and "Down" keys to select the number; confirm the modification with the "Enter" key. The value is settable over the entire range of the sensor as specified.
- 14) **Up Sc** [3 Level Menu]  
Displays the input high scale configuration. Press "Enter" to set the high scale input value, press the "Select" key to the next menu level item or "Up" key to return to second level. If you pressed "Enter" key, you can set the high input value; press the "Select" key to highlight the character you want to change and then the "Up" and "Down" keys to select the number; confirm the modification with the "Enter" key. The value is settable over the entire range of the sensor as specified.
- 15) **Burn** [3 Level Menu]  
Displays the burnout configuration. Press "Enter" to set the burnout condition, press the "Select" key to the next menu level item or "Up" key to return to second level. If you pressed "Enter" key, you can choose between 3 different burnout conditions; press "Select" key to change the burnout and then the "Enter" key to confirm the choice. The condition types are:  
none no burnout detection, the analog output follows the input value  
br dn when in burnout condition, the analog output goes to down scale (0 mA or 0 V)  
br up when in burnout condition, the analog output goes to high scale (22 mA or 11 V)
- 16) **Alr A / Alr B** [3 Level Menu]  
Displays the Alarm A / Alarm B configuration menu. Press "Enter" to set the alarm condition, press the "Select" key to the next menu level item or "Up" key to return to second level.
- 17) **Type** [4 Level Menu]  
Displays the alarm type (A or B) configuration. Press "Enter" to set the alarm condition, press the "Select" key to the next menu level item or "Up" key to return to third level. If you pressed "Enter" key, you can choose between 5 different alarm conditions; press "Select" key to change the type and then the "Enter" key to confirm the choice. The condition types are:  
OFF no alarm detection, the relay output is always in normal condition  
HI high alarm condition, the relay output change status when an alarm condition is detected (input variable goes above the set value)  
LO low alarm condition, the relay output change status when an alarm condition is detected (input variable goes below the set value)  
LOSEC low with start-up alarm condition, the relay output change status when an alarm condition after the start-up is detected (input variable starts below the set value but no alarm condition is signaled, after the warm-up the variable goes above the set value arming the alarm detection, then when the variable goes below the set value the alarm condition is signaled)  
BURN burnout alarm condition, the alarm condition change status when a burnout condition appear in the input sensor.
- 18) **B Ope** [4 Level Menu]  
Displays the functionality of alarm in burnout condition (A or B) configuration. Press "Enter" to set the burnout alarm condition, press the "Select" key to the next menu level item or "Up" key to return to third level. If you pressed "Enter" key, you can choose between 4 different alarm burnout conditions; press "Select" key to change the type and then the "Enter" key to confirm the choice. The types are:  
OFF the alarm goes in disabled condition when a burnout is detected  
NOR the alarm follow the condition of input variable (not relevant burnout)  
LOCK the alarm is locked in the same position as before a burnout is detected  
ON the alarm goes in enabled condition when a burnout is detected  
Note that a minimum of 1 second delay ("On dl" item) is necessary to obtain the burnout detection on alarm conditions.
- 19) **Relay** [4 Level Menu]  
Displays the relay normal condition (A or B) configuration. Press "Enter" to set the relay condition, press the "Select" key to the next menu level item or "Up" key to return to third level. If you pressed "Enter" key, you can choose between 2 different relay conditions; press "Select" key to change the type and then the "Enter" key to confirm the choice. The condition types are:  
ND relay normally de-energized (energized in alarm condition)  
NE relay normally energized (de-energized in alarm condition), for SIL applications
- 20) **Hyst** [4 Level Menu]  
Displays the alarm hysteresis value (A or B) configuration. Press "Enter" to set the deadband value, press the "Select" key to the next menu level item or "Up" key to return to third level. If you pressed "Enter" key, you can set the hysteresis value (engineering value); press the "Select" key to highlight the character you want to change and then the "Up" and "Down" keys to select the number; confirm the modification with the "Enter" key. The value is settable from 0 to 5000 points regarding the input sensor as specified.
- 21) **On dly** [4 Level Menu]  
Displays the alarm activation delay (A or B) configuration. Press "Enter" to set the delay time value, press the "Select" key to the next menu level item or "Up" key to return to third level. If you pressed "Enter" key, you can set the delay value (100 ms step); press the "Select" key to highlight the character you want to change and then the "Up" and "Down" keys to select the number; confirm the modification with the "Enter" key. The value is settable from 0 to 1000 seconds in steps of 100 ms.
- 22) **OF dly** [4 Level Menu]  
Displays the alarm de-activation delay (A or B) configuration. Press "Enter" to set the delay time value, press the "Select" key to the next menu level item or "Up" key to return to third level. If you pressed "Enter" key, you can set the delay value (100 ms step); press the "Select" key to highlight the character you want to change and then the "Up" and "Down" keys to select the number; confirm the modification with the "Enter" key. The value is settable from 0 to 1000 seconds in steps of 100 ms.

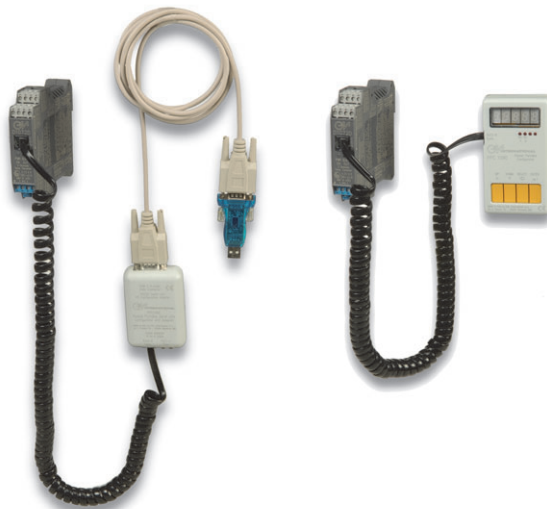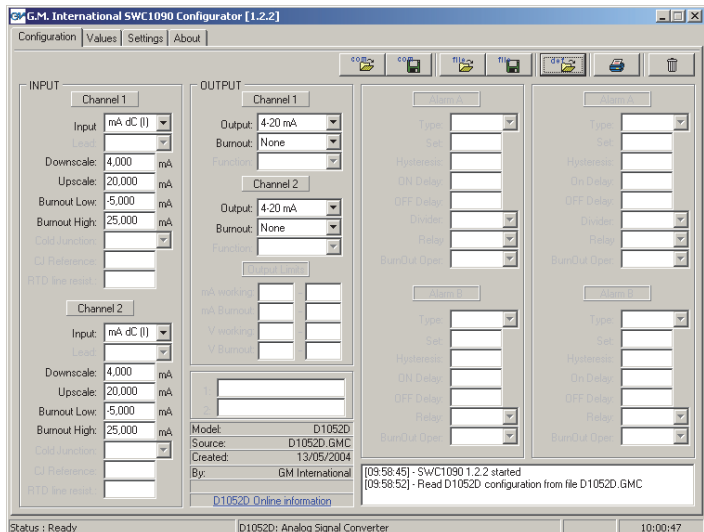

**INPUT SECTION:**

- Sensor:** input sensor type
- TC A1 thermocouple to ST190, GOST R.585 2001 range from -10 to +2500 °C
  - TC A2 thermocouple to ST190, GOST R.585 2001 range from -10 to +1800 °C
  - TC A3 thermocouple to ST190, GOST R.585 2001 range from -10 to +1800 °C
  - TC B thermocouple to ST190, NBS125, GOST R.585 2001 range from +50 to +1800 °C
  - TC E thermocouple to ST190, NBS125, GOST R.585 2001 range from -250 to +1000 °C
  - TC J thermocouple to ST190, NBS125, GOST R.585 2001 range from -200 to +750 °C
  - TC K thermocouple to ST190, NBS125, GOST R.585 2001 range from -250 to +1350 °C
  - TC L thermocouple to SIPT68, DIN43710 range from -200 to +800 °C
  - TC Lr thermocouple to ST190, GOST R.585 2001 range from -200 to +800 °C
  - TC N thermocouple to ST190, NBS121, GOST R.585 2001 range from -250 to +1300 °C
  - TC R thermocouple to ST190, NBS125, GOST R.585 2001 range from -50 to +1750 °C
  - TC S thermocouple to ST190, NBS125, GOST R.585 2001 range from -50 to +1750 °C
  - TC S1 thermocouple type S1 to SIPT68, russian range from -50 to +1600 °C
  - TC T thermocouple to ST190, NBS125, GOST R.585 2001 range from -250 to +400 °C
  - TC U thermocouple to SIPT68, DIN43710 range from -200 to +400 °C
  - Pt 100 thermoresistance  $\alpha=385$  to SIPT68, IEC751 range from -200 to +850 °C
  - Pt 200 thermoresistance  $\alpha=385$  to SIPT68, IEC751 range from -150 to +400 °C
  - Pt 300 thermoresistance  $\alpha=385$  to SIPT68, IEC751 range from -150 to +250 °C
  - Pp 100 thermoresistance  $\alpha=392$  to SIPT68, ANSI range from -200 to +625 °C
  - Pi 500 thermoresistance  $\alpha=391$  to SIPT68, russian range from -200 to +75 °C
  - Pi 100 thermoresistance  $\alpha=391$  to SIPT68, russian range from -200 to +650 °C
  - Pi 50 thermoresistance  $\alpha=391$  to SIPT68, russian range from -200 to +650 °C
  - Ni 100 thermoresistance to SIPT68, DIN43760 range from -50 to +180 °C
  - Ni 120 thermoresistance  $\alpha=672$  to SIPT68, russian range from -75 to +300 °C
  - Cu 100 thermoresistance to SIPT68, russian range from -50 to +200 °C
  - Cu 53 thermoresistance to SIPT68, russian range from -50 to +180 °C
  - Cu 50 thermoresistance to SIPT68, russian range from -50 to +200 °C
  - Cu 46 thermoresistance to SIPT68, russian range from -200 to +650 °C
  - Pot 3 wires transmitting potentiometer, 50  $\Omega$  to 20 K $\Omega$ , range from 0 to 100 %
  - E DC millivolt signal range from -20 to +85 mV
- Lead:** input sensor connection type (thermoresistance only)
- 3 wire 3 wires connection type
  - 4 wire 4 wires connection type
- Downscale:** input value of measuring range corresponding to defined low output value.
- Upscale:** input value of measuring range corresponding to defined high output value.
- Cold Junction:** reference junction compensation type (thermocouple only)
- Automatic ambient temperature compensation automatic by OPT1091 sensor
  - Fixed programmable temperature compensation at fixed temperature
- CJ Reference:** temperature compensation value (Cold Junction type Fixed only), range from -60 to +100 °C.
- RTD line resist:** line resistance error compensation value (thermoresistance only), range from -5 to +20  $\Omega$ .

**INPUT TAG SECTION:**

1: channel tag.

**OUTPUT SECTION:**

- Output:** analog output type
- 4-20 mA current output range from 4 to 20 mA (for SIL applications)
  - 0-20 mA current output range from 0 to 20 mA
  - 1-5 V voltage output range from 1 to 5 V
  - 0-5 V voltage output range from 0 to 5 V
  - 2-10 V voltage output range from 2 to 10 V
  - 0-10 V voltage output range from 0 to 10 V
- Burnout:** analog output burnout state
- None burnout function is disabled; analog output represents the input measure as configured
  - Downscale analog output is forced at mA Burnout or V Burnout lower value
  - Upscale analog output is forced at mA Burnout or V Burnout higher value
- Output Limits:** current or voltage analog output normal working range limits or burnout detection range limits:
- mA working:** current analog output range in normal working condition.
- mA Burnout:** current analog output lower and higher value for burnout signalation.
- V working:** voltage analog output range in normal working condition.
- V Burnout:** voltage analog output lower and higher value for burnout signalation.

**ALARM SECTION:**

- Type:** alarm type configuration
- Off alarm functionality is disabled
  - High alarm is set to high condition, the alarm output is triggered whenever the input variable goes above the trip point value (Set)
  - Low alarm is set to low condition, the alarm output is triggered whenever the input variable goes below the trip point value (Set)
  - Low & Sec alarm is set to low condition with start-up, the alarm output is inhibited until the input variable goes above the trip point value (Set); afterwards it behaves as a Low configuration; typically used to solve start-up issues
  - Burnout a burnout condition of the input triggers the alarm output
- Set:** input value of measuring range at which the alarm output is triggered
- Hysteresis:** alarm hysteresis value, valid range: 0 to 5 °C for temperature sensor input; 0 to 50 mV for voltage input, 0 to 50 % for potentiometer input.
- ON Delay:** time for which the input variable has to be in alarm condition before the alarm output is triggered; configurable from 0 to 1000 seconds in steps of 100 ms.
- OFF Delay:** time for which the input variable has to be in normal condition before the alarm output is deactivated; configurable from 0 to 1000 seconds in steps of 100 ms.
- Relay:** relay condition
- ND the relay is in normally de-energized condition, it energizes (the output contact is closed) in alarm condition
  - NE the relay is in normally energized condition (for SIL applications), it de-energizes (the output contact is opened) in alarm condition
- BurnOut Oper:** alarm status when a burnout condition is detected
- Nor the burnout detection on the alarm output is disabled, the alarm follows the condition of the input variable
  - Lock maintain the same alarm condition as before the burnout detection
  - On the alarm condition is activated when a burnout is detected
  - Off the alarm condition is deactivated when a burnout is detected

Each alarm output has independent configurations.