


# WAGO-I/O-SYSTEM 750

## Manual

---

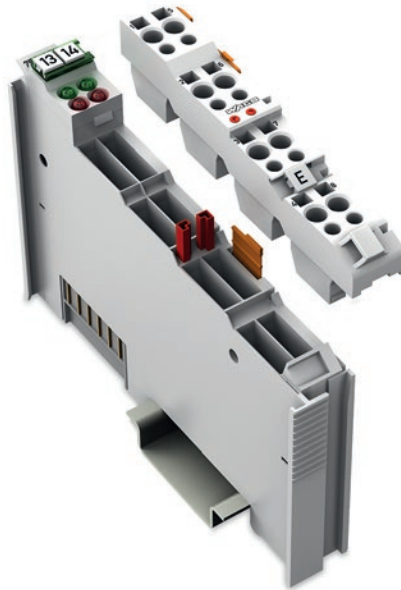

---

### **753-461 (/xxx-xxx)**

#### **2AI Pt 100/RTD**

#### **2-Channel Analog Input Module for RTDs**

Version 1.3.0

© 2016 by WAGO Kontakttechnik GmbH & Co. KG  
All rights reserved.

### **WAGO Kontakttechnik GmbH & Co. KG**

Hansastraße 27  
D-32423 Minden

Phone: +49 (0) 571/8 87 – 0  
Fax: +49 (0) 571/8 87 – 1 69

E-Mail: [info@wago.com](mailto:info@wago.com)

Web: <http://www.wago.com>

### **Technical Support**

Phone: +49 (0) 571/8 87 – 5 55  
Fax: +49 (0) 571/8 87 – 85 55

E-Mail: [support@wago.com](mailto:support@wago.com)

Every conceivable measure has been taken to ensure the accuracy and completeness of this documentation. However, as errors can never be fully excluded, we always appreciate any information or suggestions for improving the documentation.

E-Mail: [documentation@wago.com](mailto:documentation@wago.com)

We wish to point out that the software and hardware terms as well as the trademarks of companies used and/or mentioned in the present manual are generally protected by trademark or patent.

# Table of Contents

<b>1</b>	<b>Notes about this Documentation.....</b>	<b>5</b>
1.1	Validity of this Documentation.....	5
1.2	Copyright.....	6
1.3	Symbols.....	7
1.4	Number Notation.....	9
1.5	Font Conventions.....	9
<b>2</b>	<b>Important Notes .....</b>	<b>10</b>
2.1	Legal Bases .....	10
2.1.1	Subject to Changes .....	10
2.1.2	Personnel Qualifications.....	10
2.1.3	Use of the WAGO-I/O-SYSTEM 750 in Compliance with Underlying Provisions .....	10
2.1.4	Technical Condition of Specified Devices.....	11
2.2	Safety Advice (Precautions).....	12
<b>3</b>	<b>Device Description .....</b>	<b>14</b>
3.1	View .....	15
3.2	Connectors.....	16
3.2.1	Data Contacts/Internal Bus.....	16
3.2.2	Power Jumper Contacts/Field Supply .....	17
3.2.3	CAGE CLAMP® Connectors .....	17
3.3	Display Elements .....	19
3.4	Operating Elements .....	20
3.5	Schematic Diagram .....	20
3.6	Technical Data .....	21
3.6.1	Device Data .....	21
3.6.2	Power Supply.....	21
3.6.3	Communication .....	21
3.6.4	Inputs .....	21
3.6.5	Climatic Environmental Conditions.....	22
3.6.6	Connection.....	22
3.7	Approvals .....	23
3.8	Standards and Guidelines.....	25
<b>4</b>	<b>Process Image.....</b>	<b>26</b>
4.1	I/O Module with Pt Resistance Sensors .....	26
4.1.1	Pt100.....	27
4.2	750-461/003-000 Configurable I/O Module .....	27
<b>5</b>	<b>Mounting.....</b>	<b>30</b>
5.1	Mounting Sequence.....	30
5.2	Inserting and Removing Devices .....	31
5.2.1	Inserting the I/O Module .....	31
5.2.2	Removing the I/O Module.....	32
5.3	I/O Modules with Pluggable Wiring Level (Series 753) .....	33
5.3.1	Coding .....	34
5.3.2	Connector Removal.....	36

---

<b>6</b>	<b>Connect Devices .....</b>	<b>37</b>
6.1	Connecting a Conductor to the CAGE CLAMP® .....	37
6.2	Connection Examples.....	38
6.2.1	2 × RTD, 2-Wire Connection .....	38
6.2.2	2 × RTD, 3-Wire Connection .....	39
<b>7</b>	<b>Use in Hazardous Environments .....</b>	<b>40</b>
7.1	Marking Configuration Examples.....	41
7.1.1	Marking for Europe According to ATEX and IEC-Ex .....	41
7.1.2	Marking for America According to NEC 500.....	46
7.2	Installation Regulations.....	47
7.2.1	Special Conditions for Safe Use (ATEX Certificate TÜV 07 ATEX 554086 X) .....	48
7.2.2	Special Conditions for Safe Use (ATEX Certificate TÜV 12 ATEX 106032 X) .....	49
7.2.3	Special Conditions for Safe Use (IEC-Ex Certificate TUN 09.0001 X) .....	50
7.2.4	Special Conditions for Safe Use (IEC-Ex Certificate IECEX TUN 12.0039 X) .....	51
7.2.5	Special Conditions for Safe Use According to ANSI/ISA 12.12.01 .....	52
	<b>List of Figures .....</b>	<b>53</b>
	<b>List of Tables.....</b>	<b>54</b>

# 1 Notes about this Documentation

## Note



### Always retain this documentation!

This documentation is part of the product. Therefore, retain the documentation during the entire service life of the product. Pass on the documentation to any subsequent user. In addition, ensure that any supplement to this documentation is included, if necessary.

## 1.1 Validity of this Documentation

This documentation is only applicable to the I/O module 753-461 (2AI Pt 100/RTD) and the variants listed in the table below.

Table 1: Variants

Item number/Variant	Designation
<b>Pt-resistance sensors</b>	
753-461	2AI Pt 100/RTD
<b>Operating mode configurable with WAGO-I/O-CHECK</b>	
753-461/003-000	2AI Pt100/free configurable

## Note



### Documentation Validity for Variants

Unless otherwise indicated, the information given in this documentation applies to listed variants.

The I/O module 753-461 shall only be installed and operated according to the instructions in this manual and in the manual for the used fieldbus coupler/controller.

## NOTICE

### Consider power layout of the WAGO-I/O-SYSTEM 750!

In addition to these operating instructions, you will also need the manual for the used fieldbus coupler/controller, which can be downloaded at [www.wago.com](http://www.wago.com). There, you can obtain important information including information on electrical isolation, system power and supply specifications.

## 1.2 Copyright

This Manual, including all figures and illustrations, is copyright-protected. Any further use of this Manual by third parties that violate pertinent copyright provisions is prohibited. Reproduction, translation, electronic and phototechnical filing/archiving (e.g., photocopying) as well as any amendments require the written consent of WAGO Kontakttechnik GmbH & Co. KG, Minden, Germany. Non-observance will involve the right to assert damage claims.

## 1.3 Symbols

---

 **DANGER**

**Personal Injury!**

Indicates a high-risk, imminently hazardous situation which, if not avoided, will result in death or serious injury.

---

---

 **DANGER**

**Personal Injury Caused by Electric Current!**

Indicates a high-risk, imminently hazardous situation which, if not avoided, will result in death or serious injury.

---

---

 **WARNING**

**Personal Injury!**

Indicates a moderate-risk, potentially hazardous situation which, if not avoided, could result in death or serious injury.

---

---

 **CAUTION**

**Personal Injury!**

Indicates a low-risk, potentially hazardous situation which, if not avoided, may result in minor or moderate injury.

---

---

**NOTICE**

**Damage to Property!**

Indicates a potentially hazardous situation which, if not avoided, may result in damage to property.

---

---

**NOTICE**

**Damage to Property Caused by Electrostatic Discharge (ESD)!**

Indicates a potentially hazardous situation which, if not avoided, may result in damage to property.

---

---

**Note**

**Important Note!**

Indicates a potential malfunction which, if not avoided, however, will not result in damage to property.

---

## *Information*



**Additional Information:**

Refers to additional information which is not an integral part of this documentation (e.g., the Internet).

---



## 1.4 Number Notation

Table 2: Number Notation

Number Code	Example	Note
Decimal	100	Normal notation
Hexadecimal	0x64	C notation
Binary	'100' '0110.0100'	In quotation marks, nibble separated with dots (.)

## 1.5 Font Conventions

Table 3: Font Conventions

Font Type	Indicates
<i>italic</i>	Names of paths and data files are marked in italic-type. e.g.: <i>C:\Program Files\WAGO Software</i>
<b>Menu</b>	Menu items are marked in bold letters. e.g.: <b>Save</b>
>	A greater-than sign between two names means the selection of a menu item from a menu. e.g.: <b>File &gt; New</b>
<b>Input</b>	Designation of input or optional fields are marked in bold letters, e.g.: <b>Start of measurement range</b>
“Value”	Input or selective values are marked in inverted commas. e.g.: Enter the value “4 mA” under <b>Start of measurement range</b> .
<b>[Button]</b>	Pushbuttons in dialog boxes are marked with bold letters in square brackets. e.g.: <b>[Input]</b>
<b>[Key]</b>	Keys are marked with bold letters in square brackets. e.g.: <b>[F5]</b>

## 2 Important Notes

This section includes an overall summary of the most important safety requirements and notes that are mentioned in each individual section. To protect your health and prevent damage to devices as well, it is imperative to read and carefully follow the safety guidelines.

### 2.1 Legal Bases

#### 2.1.1 Subject to Changes

WAGO Kontakttechnik GmbH & Co. KG reserves the right to provide for any alterations or modifications that serve to increase the efficiency of technical progress. WAGO Kontakttechnik GmbH & Co. KG owns all rights arising from the granting of patents or from the legal protection of utility patents. Third-party products are always mentioned without any reference to patent rights. Thus, the existence of such rights cannot be excluded.

#### 2.1.2 Personnel Qualifications

All sequences implemented on WAGO-I/O-SYSTEM 750 devices may only be carried out by electrical specialists with sufficient knowledge in automation. The specialists must be familiar with the current norms and guidelines for the devices and automated environments.

All changes to the coupler or controller should always be carried out by qualified personnel with sufficient skills in PLC programming.

#### 2.1.3 Use of the WAGO-I/O-SYSTEM 750 in Compliance with Underlying Provisions

Fieldbus couplers, fieldbus controllers and I/O modules found in the modular WAGO-I/O-SYSTEM 750 receive digital and analog signals from sensors and transmit them to actuators or higher-level control systems. Using programmable controllers, the signals can also be (pre-) processed.

The devices have been developed for use in an environment that meets the IP20 protection class criteria. Protection against finger injury and solid impurities up to 12.5 mm diameter is assured; protection against water damage is not ensured. Unless otherwise specified, operation of the devices in wet and dusty environments is prohibited.

Operating the WAGO-I/O-SYSTEM 750 devices in home applications without further measures is only permitted if they meet the emission limits (emissions of interference) according to EN 61000-6-3. You will find the relevant information in the section “Device Description” > “Standards and Guidelines” in the manual for the used fieldbus coupler/controller.

Appropriate housing (per 94/9/EG) is required when operating the WAGO-I/O-SYSTEM 750 in hazardous environments. Please note that a prototype test certificate must be obtained that confirms the correct installation of the system in a housing or switch cabinet.

#### **2.1.4 Technical Condition of Specified Devices**

The devices to be supplied ex works are equipped with hardware and software configurations, which meet the individual application requirements. WAGO Kontakttechnik GmbH & Co. KG will be exempted from any liability in case of changes in hardware or software as well as to non-compliant usage of devices.

Please send your request for modified and new hardware or software configurations directly to WAGO Kontakttechnik GmbH & Co. KG.

## 2.2 Safety Advice (Precautions)

For installing and operating purposes of the relevant device to your system the following safety precautions shall be observed:



### **DANGER**

#### **Do not work on devices while energized!**

All power sources to the device shall be switched off prior to performing any installation, repair or maintenance work.

### **DANGER**

#### **Install the device only in appropriate housings, cabinets or in electrical operation rooms!**

The WAGO-I/O-SYSTEM 750 and its components are an open system. As such, install the system and its components exclusively in appropriate housings, cabinets or in electrical operation rooms. Allow access to such equipment and fixtures to authorized, qualified staff only by means of specific keys or tools.

### **NOTICE**

#### **Replace defective or damaged devices!**

Replace defective or damaged device/module (e.g., in the event of deformed contacts), since the long-term functionality of device/module involved can no longer be ensured.

### **NOTICE**

#### **Protect the components against materials having seeping and insulating properties!**

The components are not resistant to materials having seeping and insulating properties such as: aerosols, silicones and triglycerides (found in some hand creams). If you cannot exclude that such materials will appear in the component environment, then install the components in an enclosure being resistant to the above-mentioned materials. Clean tools and materials are imperative for handling devices/modules.

### **NOTICE**

#### **Clean only with permitted materials!**

Clean soiled contacts using oil-free compressed air or with ethyl alcohol and leather cloths.

---

## NOTICE

**Do not use any contact spray!**

Do not use any contact spray. The spray may impair contact area functionality in connection with contamination.

---

---

## NOTICE

**Do not reverse the polarity of connection lines!**

Avoid reverse polarity of data and power supply lines, as this may damage the devices involved.

---

---

## NOTICE



**Avoid electrostatic discharge!**

The devices are equipped with electronic components that may be destroyed by electrostatic discharge when touched. Please observe the safety precautions against electrostatic discharge per DIN EN 61340-5-1/-3. When handling the devices, please ensure that environmental factors (personnel, work space and packaging) are properly grounded.

---

### 3 Device Description

The I/O module 753-461(2AI Pt 100/RTD) measures resistance at field level or evaluates platinum or nickel resistance sensors.

The resistance values are converted into temperature values. A microprocessor in the I/O module linearizes the measured resistance values and converts them into a numeric value proportional to the temperature of the selected resistance sensor.

The **WAGO-I/O-CHECK** commissioning tool can be used to configure the required operating mode.

The default setting is Pt100.

The module has two input channels allowing the direct connection of two 2- or 3-wire resistance sensors.

For example, two 3-wire sensors can be connected either to +R1, RL1 and -R1 or to +R2, RL2 and -R2.

Each input channel of a module has a shield (screen) connection (S).

The shield connection is fed directly to the carrier rail and contact is made automatically by snapping the module onto the rail.

The assignment of the connections is described in the “Connectors” section.

Connection examples are shown in section “Connecting Devices” > ... > “Connection Example(s)”.

The operating status of the channels is indicated by a green status LED per channel.

A red error LED per channel indicates a wire break, a short circuit or that the signal is outside the measuring range.

The meaning of the LEDs is described in the “Display Elements” section.

---

#### Note



##### Use a supply module!

Use a supply module for field-side power supply of downstream I/O modules.

---

The field voltage and the system voltage are electrically isolated from each other.

With consideration of the power jumper contacts, the individual modules can be arranged in any combination when configuring the fieldbus node. An arrangement in groups within the group of potentials is not necessary.

The I/O module 753-461 can be used with all fieldbus couplers/controllers of the WAGO-I/O-SYSTEM 750 (except for the economy types 750-320, -323, -324 and -327).

### 3.1 View

## Note



### Depiction of the I/O module with 753-110 Connector!

Information on this pluggable connection pertains to the 753-110 Connector, which is not included with the I/O module.

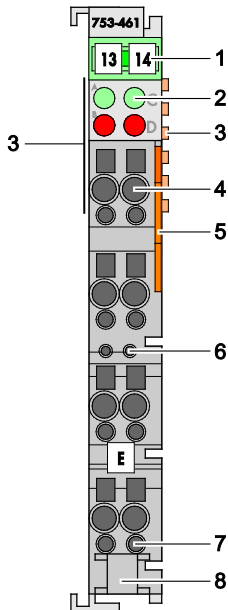


Figure 1: View

Table 4: Legend for Figure “View”

Pos.	Description	Details See Section
1	Marking possibility with Mini-WSB	---
2	Status-LEDs	“Device Description” > “Display Elements”
3	Data contacts	“Device Description” > “Connectors”
4	CAGE CLAMP® connectors	“Device Description” > “Connectors”
5	Pull tab	“Mounting” > “I/O Modules with Pluggable Wiring Level (Series 753)”
6	Coding possibility with coding fingers	“Mounting” > “Coding”
7	Test port	---
8	Fixing lug for cable ties	“Mounting” > “I/O Modules with Pluggable Wiring Level (Series 753)”

## 3.2 Connectors

### 3.2.1 Data Contacts/Internal Bus

Communication between the fieldbus coupler/controller and the I/O modules as well as the system supply of the I/O modules is carried out via the internal bus. It is comprised of 6 data contacts, which are available as self-cleaning gold spring contacts.

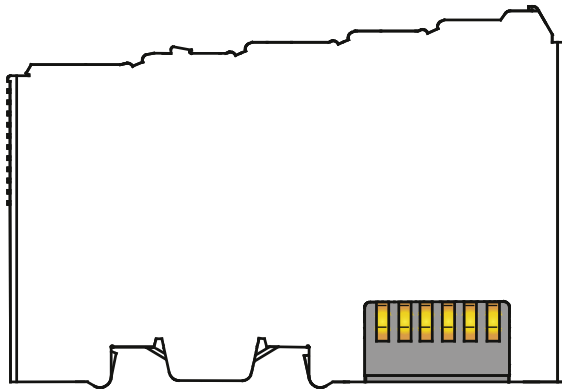


Figure 2: Data Contacts

### NOTICE

**Do not place the I/O modules on the gold spring contacts!**

Do not place the I/O modules on the gold spring contacts in order to avoid soiling or scratching!

### NOTICE



**Ensure that the environment is well grounded!**

The devices are equipped with electronic components that may be destroyed by electrostatic discharge. When handling the devices, ensure that the environment (persons, workplace and packing) is well grounded. Avoid touching conductive components, e.g. data contacts.



### 3.2.2 Power Jumper Contacts/Field Supply

The I/O module 753-461 has no power jumper contacts.

### 3.2.3 CAGE CLAMP® Connectors

#### Note



**Depiction of the I/O module with 753-110 Connector!**

Information on this pluggable connection pertains to the 753-110 Connector, which is not included with the I/O module.

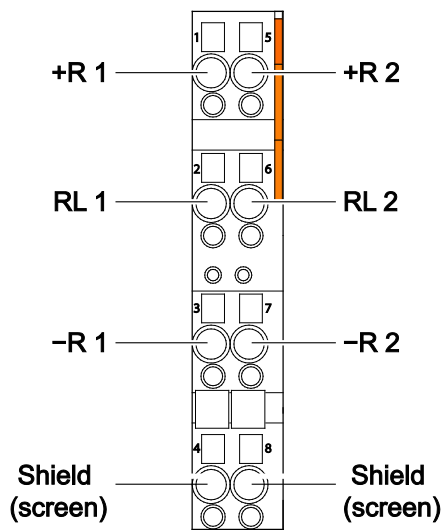


Figure 3: CAGE CLAMP® Connectors

Table 5: Legend for Figure „CAGE CLAMP® Connectors“

Channel	Designation	Connector	Function
1	+R1	1	Sensor 1: +R
	RL1	2	Sensor 1: RL
	-R1	3	Sensor 1: -R
	S	4	Shield (screen)
2	+R2	5	Sensor 2: +R
	RL2	6	Sensor 2: RL
	-R2	7	Sensor 2: -R
	S	8	Shield (screen)

## Note



### **Use shielded signal lines!**

Only use shielded signal lines for analog signals and I/O modules which are equipped with shield clamps. Only then can you ensure that the accuracy and interference immunity specified for the respective I/O module can be achieved even in the presence of interference acting on the signal cable.

### 3.3 Display Elements




Figure 4: Display Elements

Table 6: Legend for Figure “Display Elements”

Channel	LED	State	Function
1	A	Off	No operational readiness or the internal data bus communication is interrupted
		Green	Operational readiness and trouble-free internal data bus communication
	B	Off	Normal operation
		Red	Overrange/underflow of the admissible measuring range, broken wire
2	C	Off	No operational readiness or the internal data bus communication is interrupted
		Green	Operational readiness and trouble-free internal data bus communication
	D	Off	Normal operation
		Red	Overrange/underflow of the admissible measuring range, broken wire

### 3.4 Operating Elements

The I/O module 753-461 has no operating elements.

### 3.5 Schematic Diagram

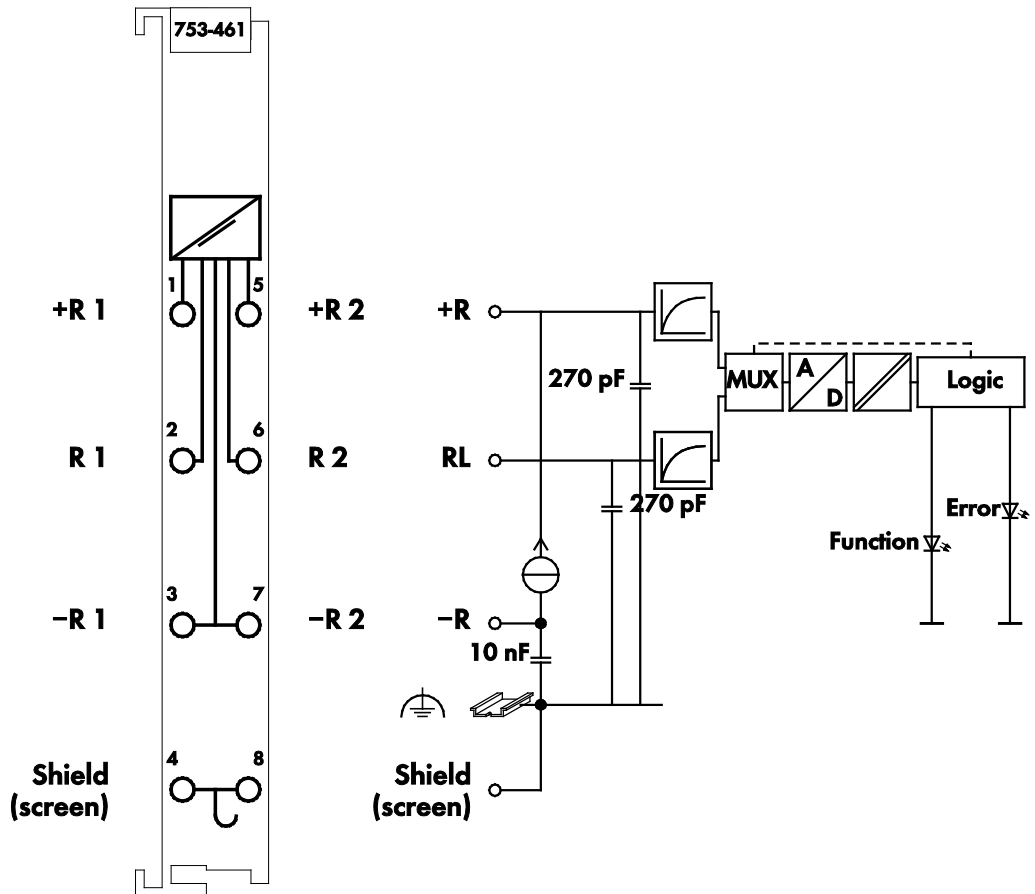


Figure 5: Schematic Diagram

## 3.6 Technical Data

### 3.6.1 Device Data

Table 7: Technical Data — Device

Width	12 mm
Height (from top edge of DIN rail)	64 mm
Depth	100 mm
Weight	approx. 52.5 g

### 3.6.2 Power Supply

Table 8: Technical Data – Power Supply

Power supply	via system voltage (DC/DC)
Current consumption, system voltage <sub>typ.</sub> (5 VDC)	80 mA
Current consumption, power jumper contact <sub>max.</sub> (24 VDC)	---
Voltage via power jumper contacts	---
Current via power jumper contacts <sub>max.</sub>	---
Isolation (peak value)	500 V system/field side

### 3.6.3 Communication

Table 9: Technical Data – Communication

Data width, internal (internal data bus) 2-channel operation	2 × 16 bit data 2 × 8 bit control/status (optional)
---	--

### 3.6.4 Inputs

Table 10: Technical Data – Inputs (RTD Model 750-461)

Number of inputs	2
Sensor types	Pt100
Sensor connection	3-wire connection (default), 2-wire connection
Temperature range	−200 °C ... +850 °C
Measuring current <sub>typ.</sub>	0.5 mA
Conversion time	320 ms (per channel)
Response delay <sup>1)</sup> <sub>max.</sub> <sup>1)</sup> Time between switching on or connecting the sensor and first valid measured value	4 s
Resolution <sup>2)</sup> <sup>2)</sup> Over entire range	0.1 °C
Measuring error at 25 °C	< ±0.2 % of full scale value
Temperature coefficient	< ±0.01 %/K of full scale value

### 3.6.5 Climatic Environmental Conditions

Table 11: Technical Data – Climatic Environmental Conditions

Operating temperature range	0 °C ... 55 °C
Operating temperature range for components with extended temperature range (750-xxx/025-xxx)	-20 °C ... +60 °C
Storage temperature range	-25 °C ... +85 °C
Storage temperature range for components with extended temperature range (750-xxx/025-xxx)	-40 °C ... +85 °C
Relative humidity	Max. 5 % ... 95 % without condensation
Resistance to harmful substances	Acc. to IEC 60068-2-42 and IEC 60068-2-43
Maximum pollutant concentration at relative humidity < 75 %	SO <sub>2</sub> ≤ 25 ppm H <sub>2</sub> S ≤ 10 ppm
Special conditions	Ensure that additional measures for components are taken, which are used in an environment involving: – dust, caustic vapors or gases – ionizing radiation

### 3.6.6 Connection

Table 12: Technical Data – Field Wiring

Wire connection	CAGE CLAMP®
Cross section	0.08 mm <sup>2</sup> ... 2.5 mm <sup>2</sup> / AWG 28 ... 14
Stripped length	9 mm ... 10 mm / 0.37 in

Table 13: Technical Data – Data Contacts

Data contacts	Slide contact, hard gold plated, self-cleaning
---------------	--

## 3.7 Approvals

### Information




#### More information about approvals.

Detailed references to the approvals are listed in the document “Overview Approvals **WAGO-I/O-SYSTEM 750**”, which you can find via the internet under: [www.wago.com](http://www.wago.com) > SERVICES > DOWNLOADS > Additional documentation and information on automation products > WAGO-I/O-SYSTEM 750 > System Description.


The following approvals have been granted to the basic version and all variants of 753-461 I/O modules:

 Conformity Marking

 cUL<sub>US</sub> UL508

 Korea Certification MSIP-REM-W43-AIM750

The following Ex approvals have been granted to the basic version and all variants of 753-461 I/O modules:

 TÜV 07 ATEX 554086 X  
I M2 Ex d I Mb  
II 3 G Ex nA IIC T4 Gc  
II 3 D Ex tc IIIC T135°C Dc

IECEX TUN 09.0001 X

Ex d I Mb  
Ex nA IIC T4 Gc  
Ex tc IIIC T135°C Dc

 cUL<sub>US</sub> ANSI/ISA 12.12.01  
Class I, Div2 ABCD T4

The following ship approvals have been granted to the variations 753-461 listed below:

										
753-461	X	X	X	X	X	X	X		X	X
753-461 /003-000				X	X	X			X	X



ABS (American Bureau of Shipping)



Federal Maritime and Hydrographic Agency



BV (Bureau Veritas)



DNV (Det Norske Veritas)

Class B



GL (Germanischer Lloyd)

Cat. A, B, C, D (EMC 1)



KR (Korean Register of Shipping)



LR (Lloyd's Register)

Env. 1, 2, 3, 4



PRS (Polski Rejestr Statków)



RINA (Registro Italiano Navale)



---

## 3.8 Standards and Guidelines

All variations of 753-461 I/O modules meet the following requirements on emission and immunity of interference:

EMC CE-Immunity to interference	acc. to EN 61000-6-2
EMC CE-Emission of interference	acc. to EN 61000-6-4
EMC marine applications-Immunity to interference	acc. to Germanischer Lloyd
EMC marine applications-Emission of interference	acc. to Germanischer Lloyd

## 4 Process Image

The I/O module transfers 16 bits per channel of measured data and, optionally, 8 status bits to the fieldbus coupler/controller. Access to the status bits depends on the specific fieldbus system.



### Note

#### Mapping of process data in the process image of fieldbus systems

The representation of the I/O modules' process data in the process image depends on the fieldbus coupler/controller used. Please take this information as well as the particular design of the respective control/status bytes from the section "Fieldbus Specific Design of the Process Data" included in the description concerning the process image of the fieldbus coupler/controller used.

### 4.1 I/O Module with Pt Resistance Sensors

Table 14: I/O Modules with Pt Resistance Sensors

753-461	Evaluation Pt100 Measuring range: -200 °C ... +850 °C
---------	--

### 4.1.1 Pt100

The 753-461 I/O module calculates the resistance measurement values from Pt100 sensors and outputs them as temperature values. The temperature values are displayed at a resolution of 1 digit per 0.1 °C in one word (16-bit). Temperature values below 0 °C are represented in two's complement binary. As a result, 0 °C corresponds to the numeric value 0x0000 and 100 °C to the numeric value 0x03E8 (dec. 1000). The possible numeric range corresponds to the defined temperature range of -200 °C ... +850 °C for Pt100 sensors.

Table 15: Process Image, Pt100, with Wire Break Diagnostics

Temperature °C	Resistance Ω	Numeric value <sup>1)</sup>			Status Byte Hex.	LED Error AI 1, 2
		Binary	Hex.	Dec.		
< -200.0	10.00	'1000.0000.0000.0001'	0x8001	-32767	0x41	ON
-200.0	18.49	'1111.1000.0011.0000'	0xF830	-2000	0x00	OFF
-100.0	60.25	'1111.1100.0001.1000'	0xFC18	-1000	0x00	OFF
0.0	100.00	'0000.0000.0000.0000'	0x0000	0	0x00	OFF
100.0	138.50	'0000.0011.1110.1000'	0x03E8	1000	0x00	OFF
200.0	175.84	'0000.0111.1101.0000'	0x07D0	2000	0x00	OFF
500.0	280.90	'0001.0011.1000.1000'	0x1388	5000	0x00	OFF
750.0	360.47	'0001.1101.0100.1100'	0x1D4C	7500	0x00	OFF
800.0	375.51	'0001.1111.0100.0000'	0x1F40	8000	0x00	OFF
850.0	390.26	'0010.0001.0011.0100'	0x2134	8500	0x00	OFF
> 850.0	> 390.26	'0010.0001.0011.0100'	0x2134	8500	0x42	ON
Wire break at R <sub>L</sub>		'0010.0001.0011.0100'	0x2134	8500	0x42	ON

The measured value can exceed a decimal range of -2000 ... +8500 before limitation takes effect.

## 4.2 750-461/003-000 Configurable I/O Module

Table 16: Configurable I/O Module

753-461/003-000	Default setting: Pt100 configurable Measuring range: -200 °C ... +850 °C
-----------------	---

The operating mode of the 753-461/003-000 I/O module version can be configured using the free WAGO-I/O-CHECK startup tool. The default setting is Pt100. In this operating mode, the I/O module has the same behavior and process values as the 753-461 standard module.

The configuration dialog in WAGO-I/O-CHECK provides selection fields for the I/O module's possible settings.

Table 17: Setting Options for the 753-461/003-000 I/O Module

Selection box	Possible settings	
RTD type	Pt100 (−200 °C ... 850 °C)* / Pt200 (−200 °C ... 850 °C) / Pt500 (−200 °C ... 850 °C) / Pt1000 (−200 °C ... 850 °C) / Ni100 (−60 °C ... 250 °C) / Ni120 (−80 °C ... 320 °C) / Ni1000 TK6180 (−60 °C ... 250 °C) / Ohm (10 ... 1200) / Ohm (10 ... 5000)	
Connection	2-wire	2-wire connection technology
	3-wire*	3-wire connection technology
Status bit	OFF*	No display of status indicators
	ON	Display of status indicators in the bottom 3 bits:  Bit 0: Overflow; set if the measured value lies outside the permissible range.  Bit 1: Error; set if the I/O module detects an error in the inner function or the input is short-circuited.  Bit 2: 0
Watchdog timer	OFF	Watchdog timer not enabled
	ON*	Watchdog time enabled; if no process data is exchanged with the fieldbus coupler/controller for 100 ms, the green LEDs go out.
Amount sign	OFF*	Two's complement representation
	ON	Amount/sign representation
Filter constants	12,5 Hz ... 500 ms / 25 Hz ... 250 ms* / 50 Hz ... 125 ms / 60 Hz ... 110 ms / 100 Hz ... 65 ms	
Overrange protection	OFF	No limiting of the output value
	ON*	If a temperature of 850 °C is exceeded, the status bits are set and the output value limited to 850 °C.
User scaling	OFF*	User scaling disabled
	ON	User scaling enabled
WAGO scaling	OFF	WAGO scaling disabled
	ON*	WAGO scaling enabled

\*Default setting

The following input fields are available in WAGO-I/O-CHECK for adjusting the offset and gain values for user and WAGO scaling:

Table 18: 753-461/003-000 I/O Module, Offset and Gain Values

Input field	...	Offset	Gain
User scaling	...	0x0000	0x0100
WAGO scaling	...	0x0000	0x00A0

The following input fields are provided in *WAGO-I/O-CHECK* for hardware matching of the I/O module:

Table 19: 753-461/003-000 I/O Module, Hardware Matching Input Fields

<b>Input field</b>	<b>Settings</b>
Offset	0xECF0
Gain	0x2700
2-Wire Offset	0x0180

## 5 Mounting

### 5.1 Mounting Sequence

Fieldbus couplers/controllers and I/O modules of the WAGO-I/O-SYSTEM 750/753 are snapped directly on a carrier rail in accordance with the European standard EN 50022 (DIN 35).

The reliable positioning and connection is made using a tongue and groove system. Due to the automatic locking, the individual devices are securely seated on the rail after installation.

Starting with the fieldbus coupler/controller, the I/O modules are mounted adjacent to each other according to the project design. Errors in the design of the node in terms of the potential groups (connection via the power contacts) are recognized, as the I/O modules with power contacts (blade contacts) cannot be linked to I/O modules with fewer power contacts.

#### CAUTION

##### **Risk of injury due to sharp-edged blade contacts!**

The blade contacts are sharp-edged. Handle the I/O module carefully to prevent injury.

#### NOTICE

##### **Insert I/O modules only from the proper direction!**

All I/O modules feature grooves for power jumper contacts on the right side. For some I/O modules, the grooves are closed on the top. Therefore, I/O modules featuring a power jumper contact on the left side cannot be snapped from the top. This mechanical coding helps to avoid configuration errors, which may destroy the I/O modules. Therefore, insert I/O modules only from the right and from the top.

#### Note



##### **Don't forget the bus end module!**

Always plug a bus end module 750-600 onto the end of the fieldbus node! You must always use a bus end module at all fieldbus nodes with WAGO-I/O-SYSTEM 750 fieldbus couplers/controllers to guarantee proper data transfer.

## 5.2 Inserting and Removing Devices

### NOTICE

**Perform work on devices only if they are de-energized!**

Working on energized devices can damage them. Therefore, turn off the power supply before working on the devices.

### 5.2.1 Inserting the I/O Module

1. Position the I/O module so that the tongue and groove joints to the fieldbus coupler/controller or to the previous or possibly subsequent I/O module are engaged.

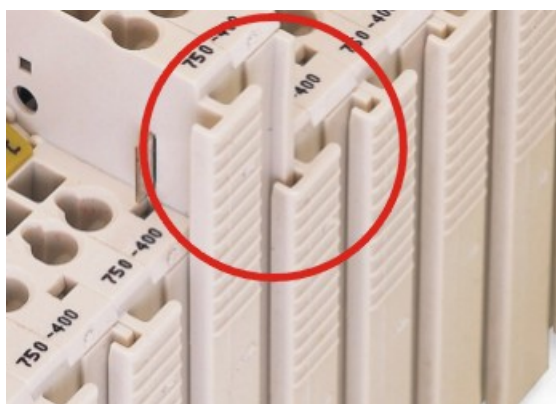


Figure 6: Insert I/O Module (Example)

2. Press the I/O module into the assembly until the I/O module snaps into the carrier rail.

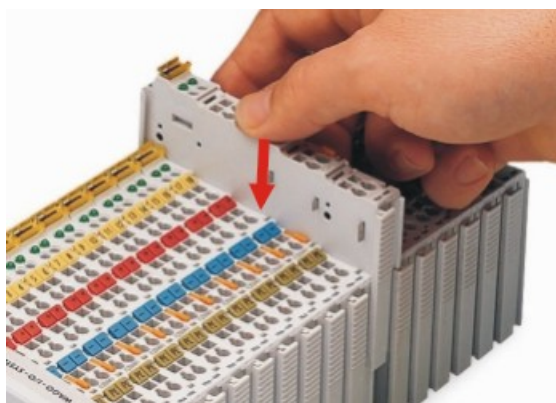


Figure 7: Snap the I/O Module into Place (Example)

With the I/O module snapped in place, the electrical connections for the data contacts and power jumper contacts (if any) to the fieldbus coupler/controller or to the previous or possibly subsequent I/O module are established.

## 5.2.2 Removing the I/O Module

### Note



#### Remove pluggable connector!

Before removing a 753 Series I/O Module from the node, you must first remove the pluggable connector from the module (see section “Connector Removal”)!

1. Remove the I/O module from the node by pulling the release tab.

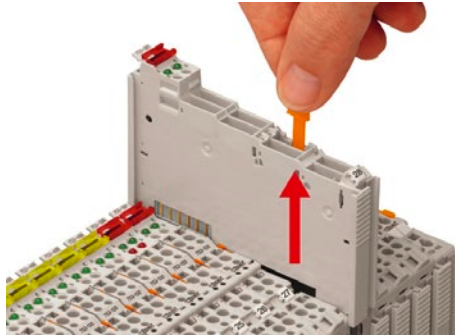


Figure 8: Removing the I/O Module (Example)

Electrical connections for data or power contacts are disconnected when removing the I/O module.



## 5.3 I/O Modules with Pluggable Wiring Level (Series 753)

Series 753 I/O modules feature a pluggable connector for I/O wiring. This connector is simply plugged into the bottom of the module. The connector can be completely removed together with the wiring, simplifying replacement of defective modules from the assembly.

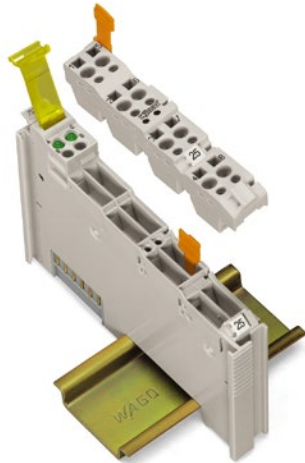


Figure 9: Connector and Module

Miniature WSB marking tags ensure that the right connector is matched up with the right I/O module (see figure below).



Figure 10: Assignment of Module to Connector Using Mini-WSB Tags

This connector provides an option for attaching cable binders.



Figure 11: Attachment of Cable Binders

### 5.3.1 Coding

Coding using small plastic pins and sockets facilitates mating of the module with the appropriate connector.

1. Insert the pin into the socket.

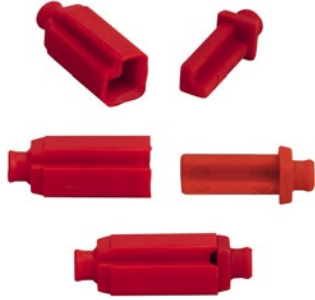


Figure 12: Assembling the Coding Fingers

2. Position the assembled coding fingers in the I/O module. Due to its design, each coding finger allows four different coding options (i.e.; 16 different options using two coding fingers).

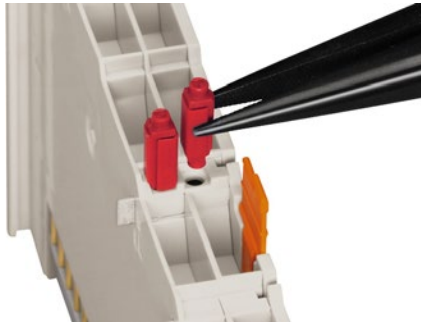


Figure 13: Inserting the Coding Fingers

3. Place the connector onto the I/O module.



Figure 14: Plugging the Connector into Place

4. When the connector is removed the sockets remain in the I/O module. The coded connector can only fit in the corresponding coded I/O module (see figures below).

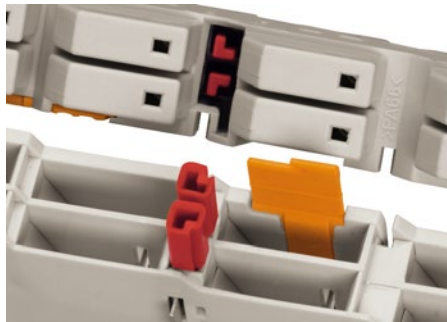


Figure 15: "Sure Match" Coding Fingers

### 5.3.2 Connector Removal

1. Remove the connector from the I/O module by pulling the orange pull tab on the connector toward the top of the module.

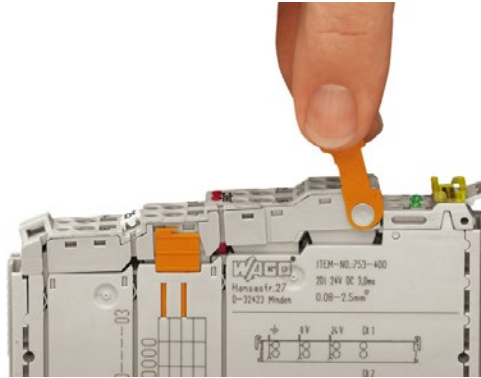


Figure 16: Pulling the Pull Tab

The connector detaches from the module.

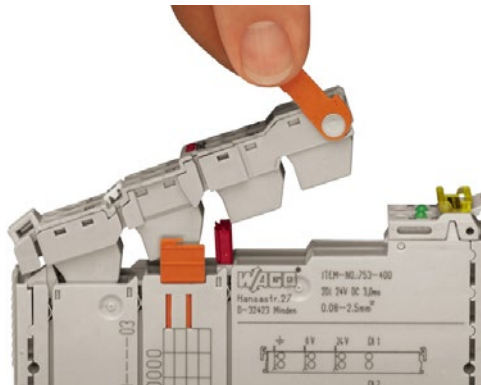


Figure 17: Removing the Connector Without Tools

2. Alternatively, you can also use a standard screwdriver at the position shown (in the figure below) to remove the connector.

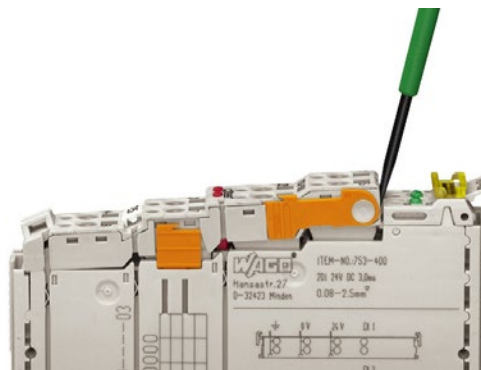


Figure 18: Removing the Connector Using a Screwdriver

## 6 Connect Devices

### 6.1 Connecting a Conductor to the CAGE CLAMP®

The WAGO CAGE CLAMP® connection is appropriate for solid, stranded and finely stranded conductors.

#### Note



**Only connect one conductor to each CAGE CLAMP®!**

Only one conductor may be connected to each CAGE CLAMP®.

Do not connect more than one conductor at one single connection!

If more than one conductor must be routed to one connection, these must be connected in an up-circuit wiring assembly, for example using WAGO feed-through terminals.

#### Exception:

If it is unavoidable to jointly connect 2 conductors, then you must use a ferrule to join the wires together. The following ferrules can be used:

Length:	8 mm
Nominal cross section <sub>max.</sub> :	1 mm <sup>2</sup> for 2 conductors with 0.5 mm <sup>2</sup> each
WAGO product:	216-103 or products with comparable properties

1. For opening the CAGE CLAMP® insert the actuating tool into the opening above the connection.
2. Insert the conductor into the corresponding connection opening.
3. For closing the CAGE CLAMP® simply remove the tool. The conductor is now clamped firmly in place.

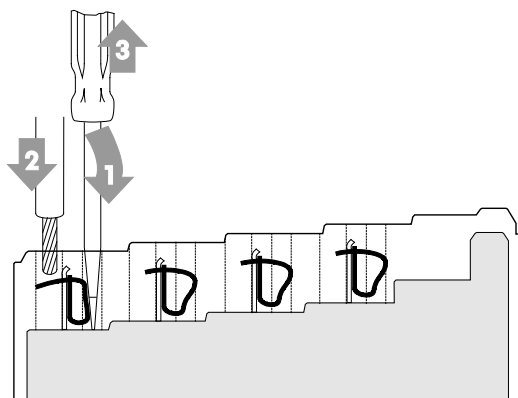


Figure 19: Connecting a Conductor to a CAGE CLAMP®

## 6.2 Connection Examples

### Note



#### Use shielded signal lines!

Only use shielded signal lines for analog signals and I/O modules which are equipped with shield clamps. Only then can you ensure that the accuracy and interference immunity specified for the respective I/O module can be achieved even in the presence of interference acting on the signal cable.

### Note



#### Depiction of the I/O module with 753-110 Connector!

Information on this pluggable connection pertains to the 753-110 Connector, which is not included with the I/O module.

### 6.2.1 2 × RTD, 2-Wire Connection

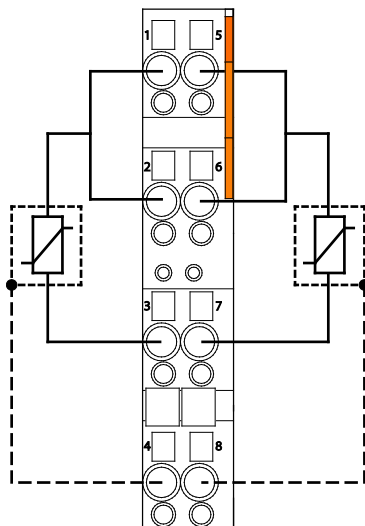


Figure 20: Connection Example: 2 × RTD, 2-Wire Connection

### 6.2.2 2 × RTD, 3-Wire Connection

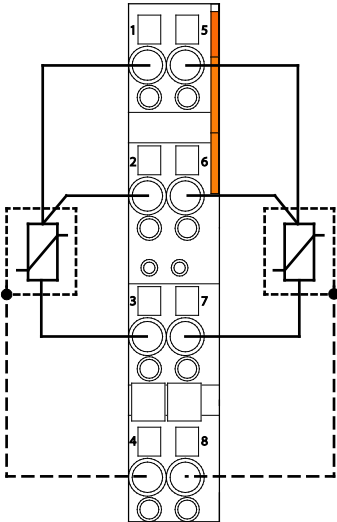


Figure 21: Connection Example: 2 × RTD, 3-Wire Connection

## 7 Use in Hazardous Environments

The **WAGO-I/O-SYSTEM 750** (electrical equipment) is designed for use in Zone 2 hazardous areas.

The following sections include both the general identification of components (devices) and the installation regulations to be observed. The individual subsections of the “Installation Regulations” section must be taken into account if the I/O module has the required approval or is subject to the range of application of the ATEX directive.



## 7.1 Marking Configuration Examples

### 7.1.1 Marking for Europe According to ATEX and IEC-Ex

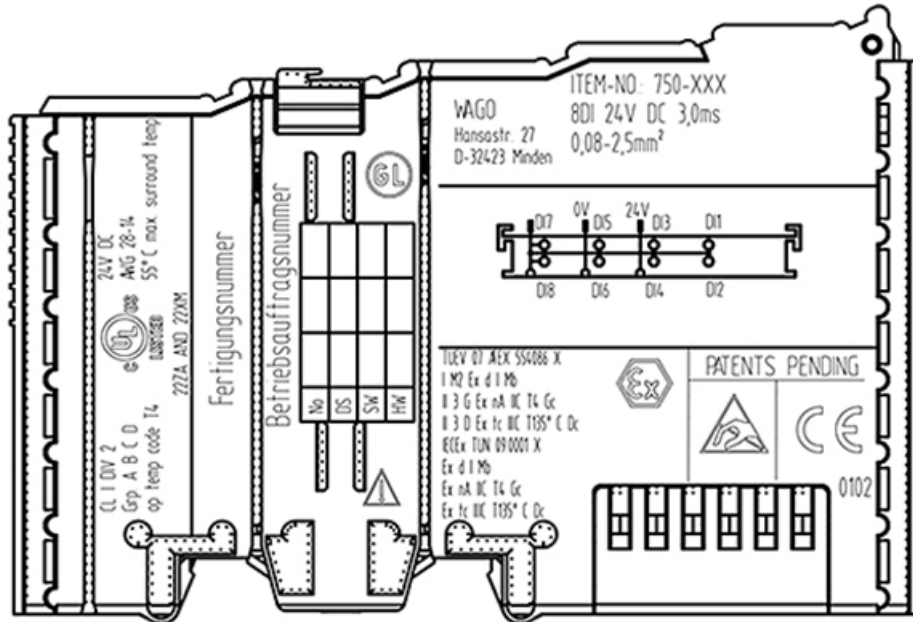


Figure 22: Side Marking Example for Approved I/O Modules According to ATEX and IECEx

TUEV 07 ATEX 554086 X  
 I M2 Ex d I Mb  
 II 3 G Ex nA IIC T4 Gc  
 II 3 D Ex tc IIC T135° C Dc  
 IECEx TUN 09.0001 X  
 Ex d I Mb  
 Ex nA IIC T4 Gc  
 Ex tc IIC T135° C Dc




Figure 23: Text Detail – Marking Example for Approved I/O Modules According to ATEX and IECEx.

Table 20: Description of Marking Example for Approved I/O Modules According to ATEX and IECEx

Printing on Text	Description
TÜV 07 ATEX 554086 X IECEx TUN 09.0001 X	Approving authority and certificate numbers
<b>Dust</b>	
II	Equipment group: All except mining
3D	Category 3 (Zone 22)
Ex	Explosion protection mark
tc Dc	Type of protection and equipment protection level (EPL): protection by enclosure
IIIC	Explosion group of dust
T 135°C	Max. surface temperature of the enclosure (without a dust layer)
<b>Mining</b>	
I	Equipment group: Mining
M2	Category: High level of protection
Ex	Explosion protection mark
d Mb	Type of protection and equipment protection level (EPL): Flameproof enclosure
I	Explosion group for electrical equipment for mines susceptible to firedamp
<b>Gases</b>	
II	Equipment group: All except mining
3G	Category 3 (Zone 2)
Ex	Explosion protection mark
nA Gc	Type of protection and equipment protection level (EPL): Non-sparking equipment
nC Gc	Type of protection and equipment protection level (EPL): Sparking apparatus with protected contacts. A device which is so constructed that the external atmosphere cannot gain access to the interior
IIIC	Explosion group of gas and vapours
T4	Temperature class: Max. surface temperature 135°C

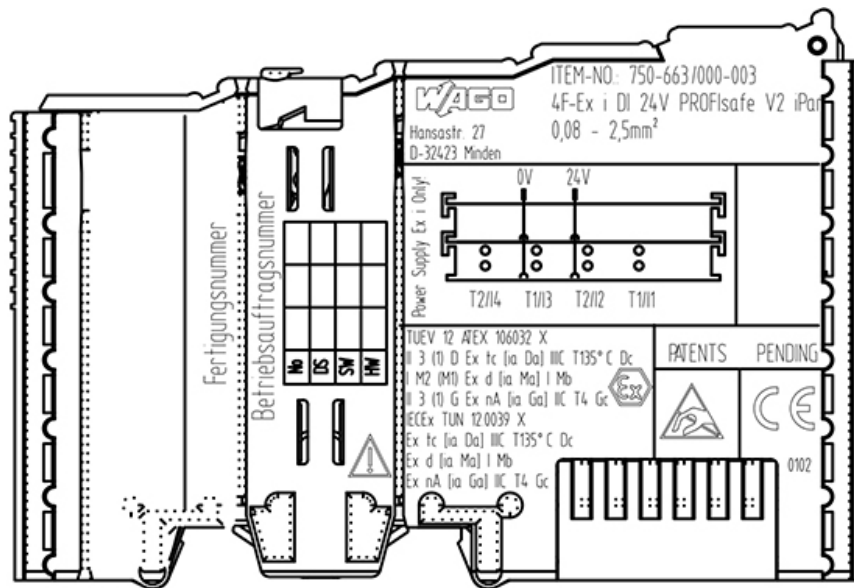


Figure 24: Side Marking Example for Approved Ex i I/O Modules According to ATEX and IECEX.


TUEV 12 ATEX 106032 X  
 II 3 (1) D Ex tc [ia Da] IIC T135° C Dc  
 I M2 (M1) Ex d [ia Ma] I Mb  
 II 3 (1) G Ex nA [ia Ga] IIC T4 Gc   
 IECEX TUN 12.0039 X  
 Ex tc [ia Da] IIC T135° C Dc  
 Ex d [ia Ma] I Mb  
 Ex nA [ia Ga] IIC T4 Gc

Figure 25: Text Detail – Marking Example for Approved Ex i I/O Modules According to ATEX and IECEX.

Table 21: Description of Marking Example for Approved Ex i I/O Modules According to ATEX and IECEx

Inscription Text	Description
TÜV 07 ATEX 554086 X IECEX TUN 09.0001X	Approving authority and certificate numbers
TÜV 12 ATEX 106032 X IECEX TUN 12.0039 X	
<b>Dust</b>	
II	Equipment group: All except mining
3(1)D	Category 3 (Zone 22) equipment containing a safety device for a category 1 (Zone 20) equipment
3(2)D	Category 3 (Zone 22) equipment containing a safety device for a category 2 (Zone 21) equipment
Ex	Explosion protection mark
tc Dc	Type of protection and equipment protection level (EPL): protection by enclosure
[ia Da]	Type of protection and equipment protection level (EPL): associated apparatus with intrinsic safety circuits for use in Zone 20
[ib Db]	Type of protection and equipment protection level (EPL): associated apparatus with intrinsic safety circuits for use in Zone 21
IIIC	Explosion group of dust
T 135°C	Max. surface temperature of the enclosure (without a dust layer)
<b>Mining</b>	
I	Equipment Group: Mining
M2 (M1)	Category: High level of protection with electrical circuits which present a very high level of protection
Ex d Mb	Explosion protection mark with Type of protection and equipment protection level (EPL): Flameproof enclosure
[ia Ma]	Type of protection and equipment protection level (EPL): associated apparatus with intrinsic safety electrical circuits
I	Explosion group for electrical equipment for mines susceptible to firedamp

Table 21: Description of Marking Example for Approved Ex i I/O Modules According to ATEX and IECEx

<b>Gases</b>	
II	Equipment group: All except mining
3(1)G	Category 3 (Zone 2) equipment containing a safety device for a category 1 (Zone 0) equipment
3(2)G	Category 3 (Zone 2) equipment containing a safety device for a category 2 (Zone 1) equipment
Ex	Explosion protection mark
nA Gc	Type of protection and equipment protection level (EPL): Non-sparking equipment
[ia Ga]	Type of protection and equipment protection level (EPL): associated apparatus with intrinsic safety circuits for use in Zone 0
[ia Gb]	Type of protection and equipment protection level (EPL): associated apparatus with intrinsic safety circuits for use in Zone 1
IIC	Explosion group of gas and vapours
T4	Temperature class: Max. surface temperature 135°C

### 7.1.2 Marking for America According to NEC 500

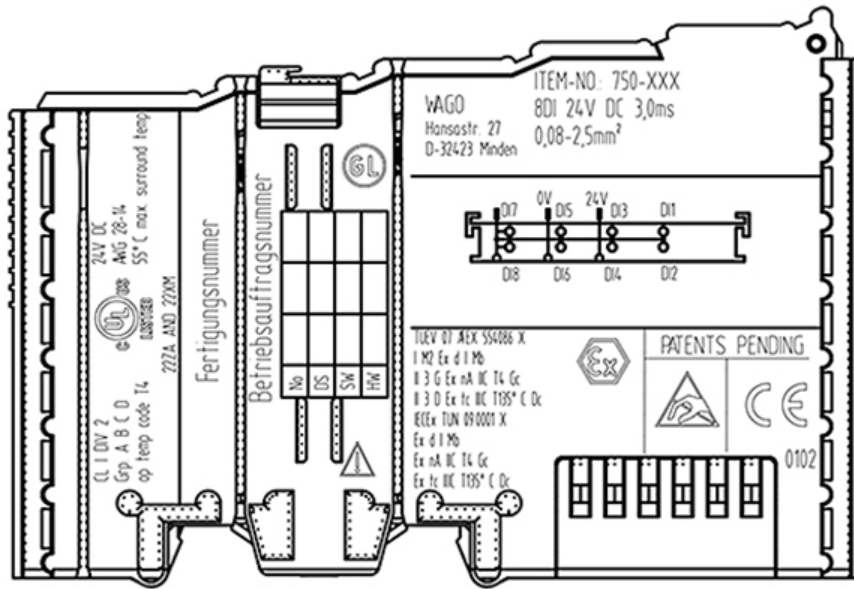


Figure 26: Side Marking Example for I/O Modules According to NEC 500

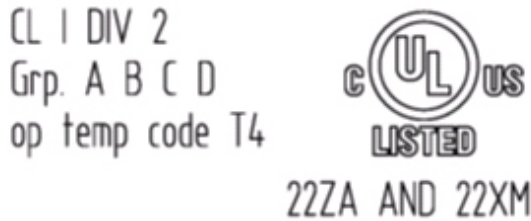


Figure 27: Text Detail – Marking Example for Approved I/O Modules According to NEC 500

Table 22: Description of Marking Example for Approved I/O Modules According to NEC 500

Printing on Text	Description
CL I	Explosion protection group (condition of use category)
DIV 2	Area of application
Grp. ABCD	Explosion group (gas group)
Op temp code T4	Temperature class

## 7.2 Installation Regulations

For the installation and operation of electrical equipment in hazardous areas, the valid national and international rules and regulations which are applicable at the installation location must be carefully followed.

## 7.2.1 Special Conditions for Safe Use (ATEX Certificate TÜV 07 ATEX 554086 X)

1. For use as Gc- or Dc-apparatus (in zone 2 or 22) the Field bus Independent I/O Modules WAGO-I/O-SYSTEM 750-\*\*\* shall be erected in an enclosure that fulfils the requirements of the applicable standards (see the marking) EN 60079-0, EN 60079-11, EN 60079-15 and EN 60079-31. For use as group I electrical apparatus M2 the apparatus shall be erected in an enclosure that ensures a sufficient protection according to EN 60079-0 and EN 60079-1 and the degree of protection IP64. The compliance of these requirements and the correct installation into an enclosure or a control cabinet of the devices shall be certified by an ExNB.
2. Measures have to be taken outside of the device that the rating voltage is not being exceeded of more than 40 % because of transient disturbances.
3. Dip-switches, binary-switches and potentiometers, connected to the module may only be actuated when explosive atmosphere can be excluded.
4. The connecting and disconnecting of the non-intrinsically safe circuits is only permitted during installation, for maintenance or for repair purposes. The temporal coincidence of explosion hazardous atmosphere and installation, maintenance resp. repair purposes shall be excluded. This is although and in particular valid for the interfaces “Memory-Card”, “USB”, “Fieldbus connection”, “Configuration and programming interface”, “antenna socket”, “D-Sub”, “DVI-port” and the “Ethernet interface”. These interfaces are not energy limited or intrinsically safe circuits. An operating of those circuits is in the behalf of the operator.
5. For the types 750-606, 750-625/000-001, 750-487/003-000, 750-484 and 750-633 the following shall be considered: The Interface circuits shall be limited to overvoltage category I/II/III (non mains/mains circuits) as defined in EN 60664-1.
6. For replaceable fuses the following shall be considered: Do not remove or replace the fuse when the apparatus is energized.
7. The following warnings shall be placed nearby the unit:  
WARNING – DO NOT REMOVE OR REPLACE FUSE WHEN ENERGIZED  
WARNING – DO NOT SEPARATE WHEN ENERGIZED  
WARNING – SEPARATE ONLY IN A NON-HAZARDOUS AREA



## 7.2.2 Special Conditions for Safe Use (ATEX Certificate TÜV 12 ATEX 106032 X)

1. For use as Gc- or Dc-apparatus (in zone 2 or 22) the Field bus Independent I/O Modules WAGO-I/O-SYSTEM 750-\*\*\* Ex i shall be erected in an enclosure that fulfils the requirements of the applicable standards (see the marking) EN 60079-0, EN 60079-11, EN 60079-15 and EN 60079-31. For use as group I electrical apparatus M2 the apparatus shall be erected in an enclosure that ensures a sufficient protection according to EN 60079-0 and EN 60079-1 and the degree of protection IP64. The compliance of these requirements and the correct installation into an enclosure or a control cabinet of the devices shall be certified by an ExNB.
2. Measures have to be taken outside of the device that the rating voltage is not being exceeded of more than 40 % because of transient disturbances.
3. The connecting and disconnecting of the non-intrinsically safe circuits is only permitted during installation, for maintenance or for repair purposes. The temporal coincidence of explosion hazardous atmosphere and installation, maintenance resp. repair purposes shall be excluded.
4. For the type the following shall be considered: The Interface circuits shall be limited to overvoltage category I/II (non mains/mains circuits) as defined in EN 60664-1.

### 7.2.3 Special Conditions for Safe Use (IEC-Ex Certificate TUN 09.0001 X)

1. For use as Gc- or Dc-apparatus (in zone 2 or 22) the Field bus Independent I/O Modules WAGO-I/O-SYSTEM 750-\*\*\* shall be erected in an enclosure that fulfils the requirements of the applicable standards (see the marking) IEC 60079-0, IEC 60079-11, IEC 60079-15 and IEC 60079-31. For use as group I electrical apparatus M2 the apparatus shall be erected in an enclosure that ensures a sufficient protection according to IEC 60079-0 and IEC 60079-1 and the degree of protection IP64.  
The compliance of these requirements and the correct installation into an enclosure or a control cabinet of the devices shall be certified by an ExCB.
2. Measures have to be taken outside of the device that the rating voltage is not being exceeded of more than 40 % because of transient disturbances.
3. DIP-switches, binary-switches and potentiometers, connected to the module may only be actuated when explosive atmosphere can be excluded.
4. The connecting and disconnecting of the non-intrinsically safe circuits is only permitted during installation, for maintenance or for repair purposes. The temporal coincidence of explosion hazardous atmosphere and installation, maintenance resp. repair purposes shall be excluded.  
This is although and in particular valid for the interfaces “Memory-Card”, “USB”, “Fieldbus connection”, “Configuration and programming interface”, “antenna socket”, “D-Sub”, “DVI-port” and the “Ethernet interface”. These interfaces are not energy limited or intrinsically safe circuits. An operating of those circuits is in the behalf of the operator.
5. For the types 750-606, 750-625/000-001, 750-487/003-000, 750-484 and 750-633 the following shall be considered: The Interface circuits shall be limited to overvoltage category I/II/III (non mains/mains circuits) as defined in IEC 60664-1.
6. For replaceable fuses the following shall be considered: Do not remove or replace the fuse when the apparatus is energized.
7. The following warnings shall be placed nearby the unit:  
WARNING – DO NOT REMOVE OR REPLACE FUSE WHEN ENERGIZED  
WARNING – DO NOT SEPARATE WHEN ENERGIZED  
WARNING – SEPARATE ONLY IN A NON-HAZARDOUS AREA

## 7.2.4 Special Conditions for Safe Use (IEC-Ex Certificate IECEx TUN 12.0039 X)

1. For use as Gc- or Dc-apparatus (in zone 2 or 22) the Field bus independent I/O Modules WAGO-I/O-SYSTEM 750-\*\*\* Ex i shall be erected in an enclosure that fulfils the requirements of the applicable standards (see the marking) IEC 60079-0, IEC 60079-11, IEC 60079-15, IEC 60079-31.  
For use as group I electrical apparatus M2 the apparatus shall be erected in an enclosure that ensures a sufficient protection according to IEC 60079-0 and IEC 60079-1 and the degree of protection IP64.  
The compliance of these requirements and the correct installation into an enclosure or a control cabinet of the devices shall be certified by an ExCB.
2. Measures have to be taken outside of the device that the rating voltage is not being exceeded of more than 40 % because of transient disturbances.
3. The connecting and disconnecting of the non-intrinsically safe circuits is only permitted during installation, for maintenance or for repair purposes.  
The temporal coincidence of explosion hazardous atmosphere and installation, maintenance resp. repair purposes shall be excluded.
4. For the type the following shall be considered: The Interface circuits shall be limited to overvoltage category I/II (non mains/mains circuits) as defined in IEC 60664-1.

## 7.2.5 Special Conditions for Safe Use According to ANSI/ISA 12.12.01

- A. “This equipment is suitable for use in Class I, Division 2, Groups A, B, C, D or non-hazardous locations only.”
- B. “This equipment is to be fitted within tool-secured enclosures only.”
- C. “WARNING Explosion hazard - substitution of components may impair suitability for Class I, Div. 2.”
- D. “WARNING – Do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous” has to be placed near each operator accessible connector and fuse holder.
- E. When a fuse is provided, the following information shall be provided: “A switch suitable for the location where the equipment is installed shall be provided to remove the power from the fuse.”
- F. For devices with EtherCAT/Ethernet connectors “Only for use in LAN, not for connection to telecommunication circuits.”
- G. “WARNING - Use Module 750-642 only with antenna module 758-910.”
- H. For Couplers/Controllers and Economy bus modules only: The instructions shall contain the following: “The configuration interface Service connector is for temporary connection only. Do not connect or disconnect unless the area is known to be non-hazardous. Connection or disconnection in an explosive atmosphere could result in an explosion.”
- I. Modules containing fuses only: “WARNING - Devices containing fuses must not be fitted into circuits subject to over loads, e.g. motor circuits.”
- J. Modules containing SD card reader sockets only: “WARNING - Do not connect or disconnect SD-Card while circuit is live unless the area is known to be free of ignitable concentrations of flammable gases or vapors.”



### Information

#### Additional Information

Proof of certification is available on request.

Also take note of the information given on the operating and assembly instructions.

The manual, containing these special conditions for safe use, must be readily available to the user.

## List of Figures

Figure 1: View .....	15
Figure 2: Data Contacts .....	16
Figure 3: CAGE CLAMP® Connectors .....	17
Figure 4: Display Elements .....	19
Figure 5: Schematic Diagram .....	20
Figure 6: Insert I/O Module (Example) .....	31
Figure 7: Snap the I/O Module into Place (Example) .....	31
Figure 8: Removing the I/O Module (Example) .....	32
Figure 9: Connector and Module .....	33
Figure 10: Assignment of Module to Connector Using Mini-WSB Tags .....	33
Figure 11: Attachment of Cable Binders .....	33
Figure 12: Assembling the Coding Fingers .....	34
Figure 13: Inserting the Coding Fingers .....	34
Figure 14: Plugging the Connector into Place .....	34
Figure 15: “Sure Match” Coding Fingers .....	35
Figure 16: Pulling the Pull Tab .....	36
Figure 17: Removing the Connector Without Tools .....	36
Figure 18: Removing the Connector Using a Screwdriver .....	36
Figure 19: Connecting a Conductor to a CAGE CLAMP® .....	37
Figure 20: Connection Example: 2 × RTD, 2-Wire Connection .....	38
Figure 21: Connection Example: 2 × RTD, 3-Wire Connection .....	39
Figure 22: Side Marking Example for Approved I/O Modules According to ATEX and IECEx .....	41
Figure 23: Text Detail – Marking Example for Approved I/O Modules According to ATEX and IECEx .....	41
Figure 24: Side Marking Example for Approved Ex i I/O Modules According to ATEX and IECEx .....	43
Figure 25: Text Detail – Marking Example for Approved Ex i I/O Modules According to ATEX and IECEx .....	43
Figure 26: Side Marking Example for I/O Modules According to NEC 500 .....	46
Figure 27: Text Detail – Marking Example for Approved I/O Modules According to NEC 500 .....	46

## List of Tables

Table 1: Variants .....	5
Table 2: Number Notation.....	9
Table 3: Font Conventions .....	9
Table 4: Legend for Figure “View” .....	15
Table 5: Legend for Figure „CAGE CLAMP® Connectors“ .....	17
Table 6: Legend for Figure “Display Elements” .....	19
Table 7: Technical Data — Device .....	21
Table 8: Technical Data – Power Supply .....	21
Table 9: Technical Data – Communication.....	21
Table 10: Technical Data – Inputs (RTD Model 750-461).....	21
Table 11: Technical Data – Climatic Environmental Conditions .....	22
Table 12: Technical Data – Field Wiring.....	22
Table 13: Technical Data – Data Contacts.....	22
Table 14: I/O Modules with Pt Resistance Sensors .....	26
Table 15: Process Image, Pt100, with Wire Break Diagnostics.....	27
Table 16: Configurable I/O Module.....	27
Table 17: Setting Options for the 753-461/003-000 I/O Module.....	28
Table 18: 753-461/003-000 I/O Module, Offset and Gain Values.....	28
Table 19: 753-461/003-000 I/O Module, Hardware Matching Input Fields .....	29
Table 20: Description of Marking Example for Approved I/O Modules According to ATEX and IECEx .....	42
Table 21: Description of Marking Example for Approved Ex i I/O Modules According to ATEX and IECEx .....	44
Table 22: Description of Marking Example for Approved I/O Modules According to NEC 500 .....	46



# WE! INNOVATE!

WAGO Kontakttechnik GmbH & Co. KG  
Postfach 2880 • D-32385 Minden  
Hansastraße 27 • D-32423 Minden  
Phone: 05 71/8 87 – 0  
Fax: 05 71/8 87 – 1 69  
E-Mail: [info@wago.com](mailto:info@wago.com)  
Internet: <http://www.wago.com>

